

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Columbus, Ohio

Nº 163169

County Coshocton Township Bedford Section of Township or Lot Number S. Central
Owner Frank Haines Address Warsaw, O. Rt. #2
Location of property One mile West of Tunnel Hill

CONSTRUCTION DETAILS

Casing diameter 5" Length of casing 30-9
Type of screen 7/16" Length of screen 10
Type of pump Hand
Capacity of pump 360 G.P.M.
Depth of pump setting 30

PUMPING TEST


Pumping rate 6 G.P.M. Duration of test 20 hrs.
Drawdown 20 ft. Date 9-26-55
Developed capacity 360 G.P.M.
Static level—depth to water 30 ft.
Pump installed by Haines

WELL LOG

Formations Sandstone, shale, limestone, gravel and clay	From	To
<u>Sandy Shale</u>	<u>0 Feet</u>	<u>5</u> Ft.
<u>Black Shale</u>	<u>5</u>	<u>25</u>
<u>Sandstone</u>	<u>25</u>	<u>35</u>
<u>White Soap Stone</u>	<u>35</u>	<u>55</u>
<u>Gray Slate Shale</u>	<u>55</u>	<u>60</u>
<u>Total Depth</u>	<u>60 ft.</u>	
<u>5</u>		

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

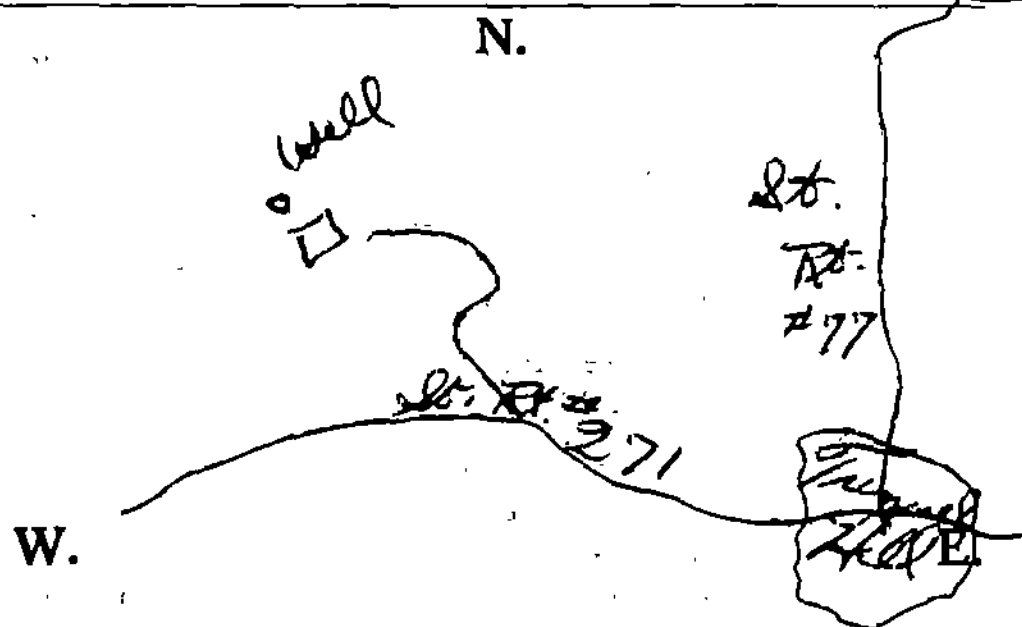

See reverse side for instructions

Drilling Firm Frank Haines Drilling Date 9-26-55
Address Frazzburgh, O. Signed F. E. Haines

7
LOCATED