

WELL LOG AND DRILLING REPORT

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
1500 Dublin Road
Columbus, Ohio

No. 217503

County Trumbull Township Liberty Section of TownshipOwner Clarence Strauss Address 62 Warner Rd. Y.O.Location of property Same

CONSTRUCTION DETAILS

Casing diameter 6" Length of casing 33'
Type of screen None Length of screen
Type of pump 1 hp Jet
Capacity of pump 10 gpm
Depth of pump setting 80 ft.
Date of completion 12-22-58

BAILING OR PUMPING TEST


Pumping rate 30 G.P.M. Duration of test 1 hrs.
Drawdown 5 ft. Date 12-20-58
Developed capacity 30 gpm
Static level—depth to water 55' ft.
Pump installed by Stewart's Pump Shop

WELL LOG

Formations Sandstone, shale, limestone, gravel and clay	From	To
<u>Clay</u>	0 Feet	<u>33</u> Ft.
<u>Shale</u>	<u>33</u>	<u>92</u>
<u>Sandstone</u>	<u>92</u>	<u>118</u>
<u>Shale</u>	<u>118</u>	<u>128</u>

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

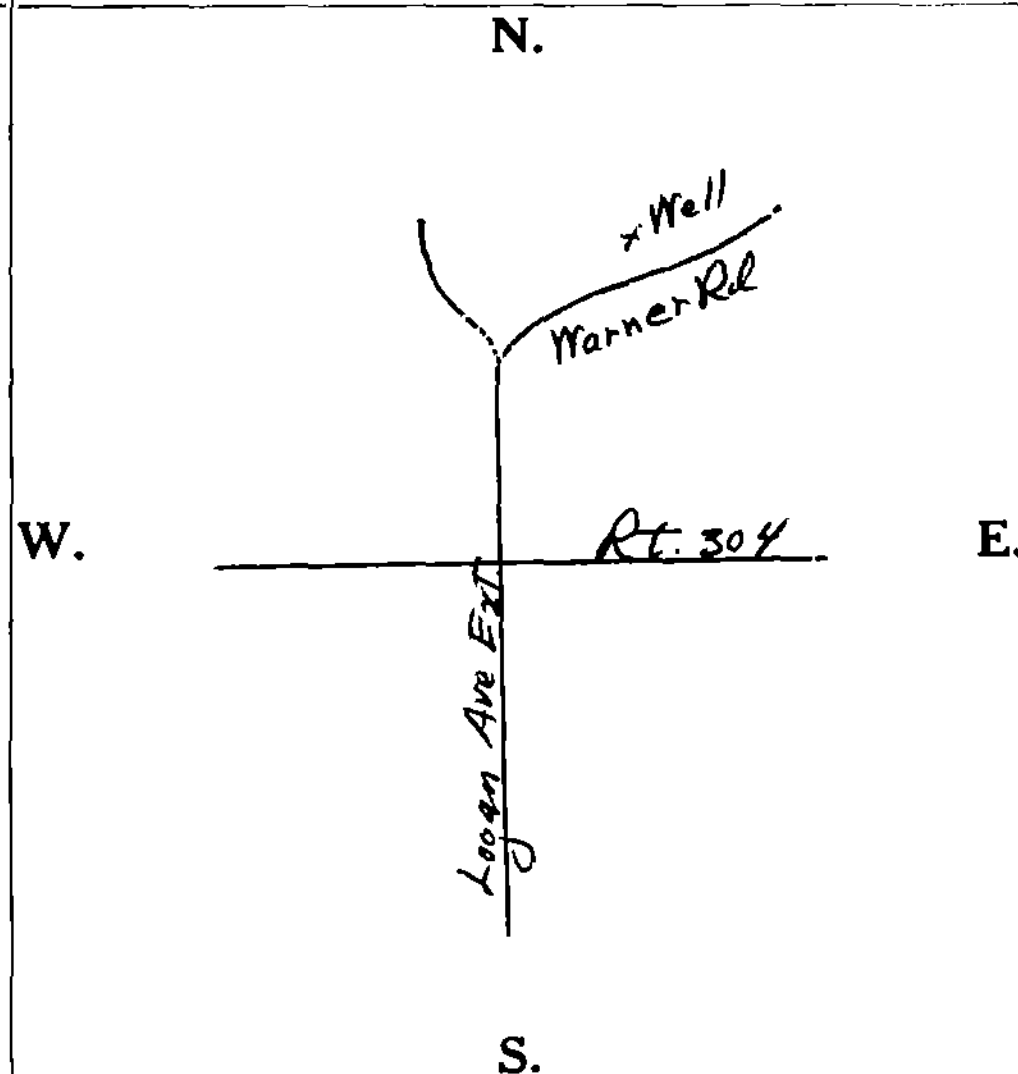

See reverse side for instructions

Drilling Firm Stewart's Pump Shop
Address 29 Hubbard Rd. Y.O.

Date 1-2-59
Signed R. Stewart