

WELL LOG AND DRILLING REPORT

State of Ohio

PLEASE USE PENCIL
OR TYPEWRITER.
DO NOT USE INK.

DEPARTMENT OF NATURAL RESOURCES

Division of Water
1562 W. First Avenue
Columbus, Ohio17c ✓
No. 243593

County Public Township Jackson Section of Township 13 ✓
 Owner Elden Foust Address R-2 - Eaton O
 Location of property Foust Nursery 1 mile W New Hope

CONSTRUCTION DETAILS

Casing diameter 6 Length of casing 84
 Type of screen Length of screen
 Type of pump
 Capacity of pump
 Depth of pump setting
 Date of completion

BAILING OR PUMPING TEST


Pumping rate 20 G.P.M. Duration of test hrs.
 Drawdown 25 ft. Date
 Developed capacity 20
 Static level—depth to water 21 ft.
 Pump installed by

WELL LOG

Formations Sandstone, shale, limestone, gravel and clay	From	To
<u>Y.C</u>	0 Feet	<u>18</u> Ft.
<u>B.C</u> <u>18-73</u>	<u>18</u>	<u>73</u>
<u>Gravel</u> <u>73-83</u>	<u>73</u>	<u>83</u>

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

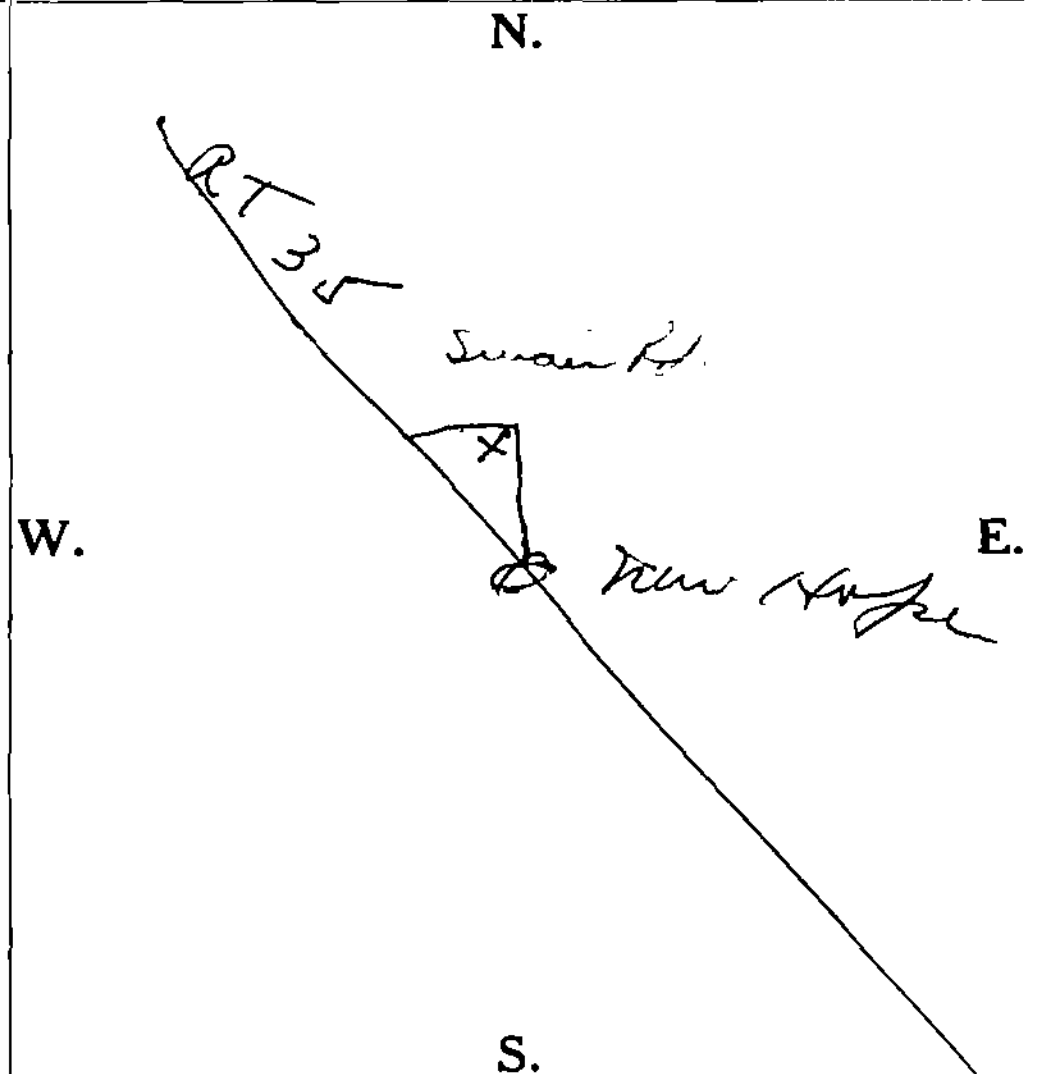

See reverse side for instructions

Drilling Firm F. Long & Panton
Eaton O
 Address

Date 3-4-67
 Signed J. A. Foust