

PLEASE USE PENCIL
OR TYPEWRITER.
DO NOT USE INK.

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
1562 W. First Avenue
Columbus, Ohio

W 32
No. 271433

County Licking Township Washington Section of Township 5 W
Owner Paul Stout Address R 70th, Zircus
Location of property Approx 3 miles NE of St Louisville on Co Rd 206

CONSTRUCTION DETAILS

Casing diameter 5" Length of casing 74' 8"
Type of screen NONE Length of screen —
Type of pump —
Capacity of pump —
Depth of pump setting —
Date of completion —

BAILING OR PUMPING TEST


Pumping rate 24 G.P.M. Duration of test 2 hrs.
Drawdown 36' ft. Date APRIL 27, 1963
Developed capacity 24
Static level—depth to water 82' ft.
Pump installed by —

WELL LOG

Formations Sandstone, shale, limestone, gravel and clay	From	To
	0 Feet	Ft.
<u>Brown shales</u>	<u>0'</u>	<u>74'</u>
<u>loafstone</u>	<u>74'</u>	<u>82'</u>
<u>Brown sandstone</u>	<u>82'</u>	<u>114'</u>
<u>water vein at</u>	<u>110'</u>	

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County Roads, etc.

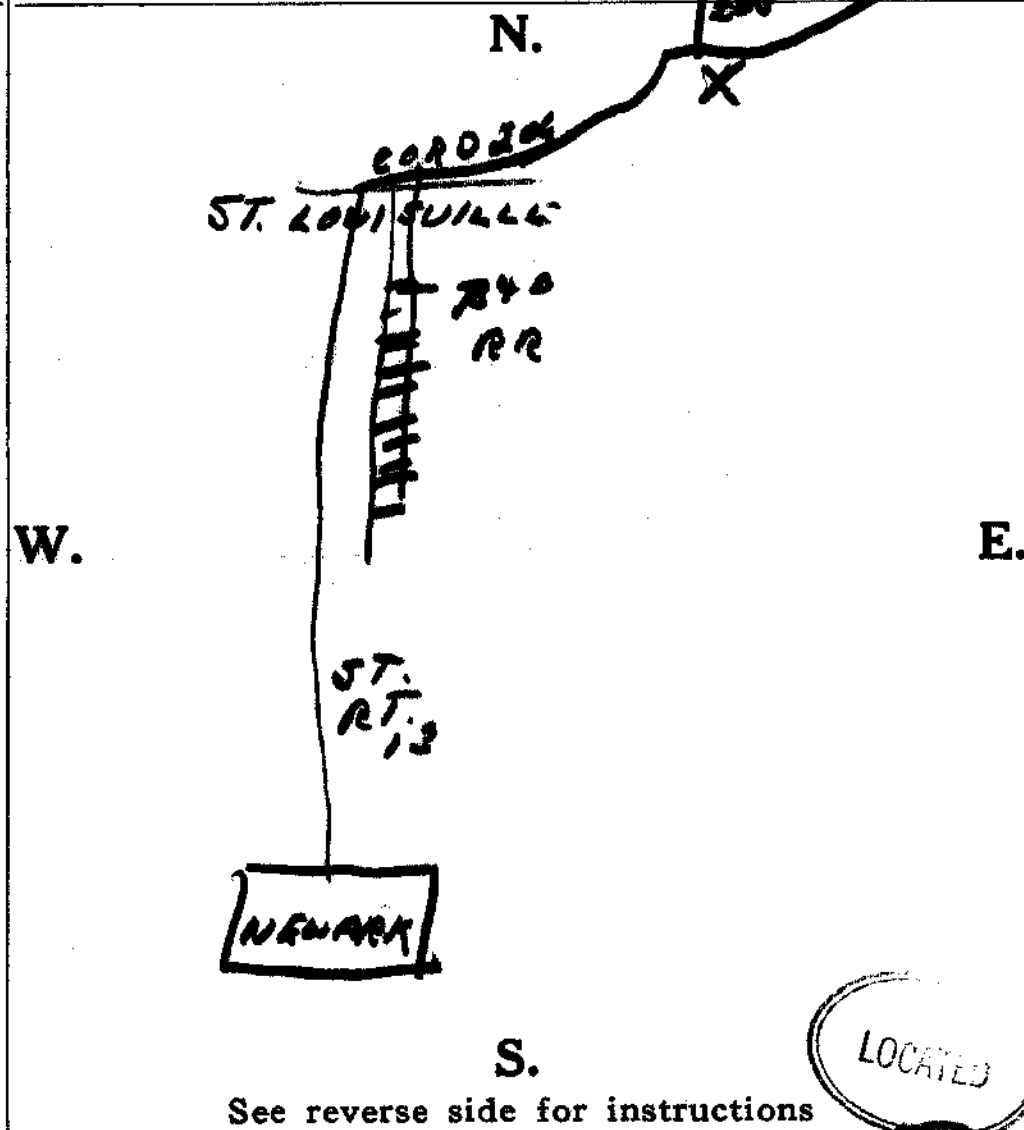

Drilling Firm GLENN C. APPELEGATE
WATER WELL DRILLING
Address 131 W. Orchard St
NEWARK, OHIO

Date April 30, 1963
Signed G. C. Applegate

