

PLEASE USE PENCIL
OR TYPEWRITER
DO NOT USE INK.

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
1562 W. First Avenue
Columbus 12, Ohio

No 287438

County Mahoning Township Goshen Section of Township
Owner Fred Eugene Weingart Address R. 2, D. # 4 Salem, Ohio
Location of property South Range Road Salem, Ohio

CONSTRUCTION DETAILS

Casing diameter 6 3/8 OD Length of casing 58 1/2 ft
Type of screen Length of screen
Type of pump
Capacity of pump
Depth of pump setting
Date of completion

BAILING OR PUMPING TEST


Pumping Rate 20 G.P.M. Duration of test 1 hrs.
Drawdown 25 ft. Date August 14, 1964
Static level-depth to water 23 ft ft.
Quality (clear, cloudy, taste, odor) Clear
18 in Hard 0.2 Perm
Pump installed by

WELL LOG

Formations Sandstone, shale, limestone, gravel and clay	From	To
	0 Feet	11 Ft.
Clay to		
Sand & Gravel	11 ft.	27 ft.
Dark shale	27 ft.	30 ft.
Coal	30 ft.	31 ft.
Gray shale	31 ft.	85 ft.
Water at 79 ft.		
14 G.P.M.		

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

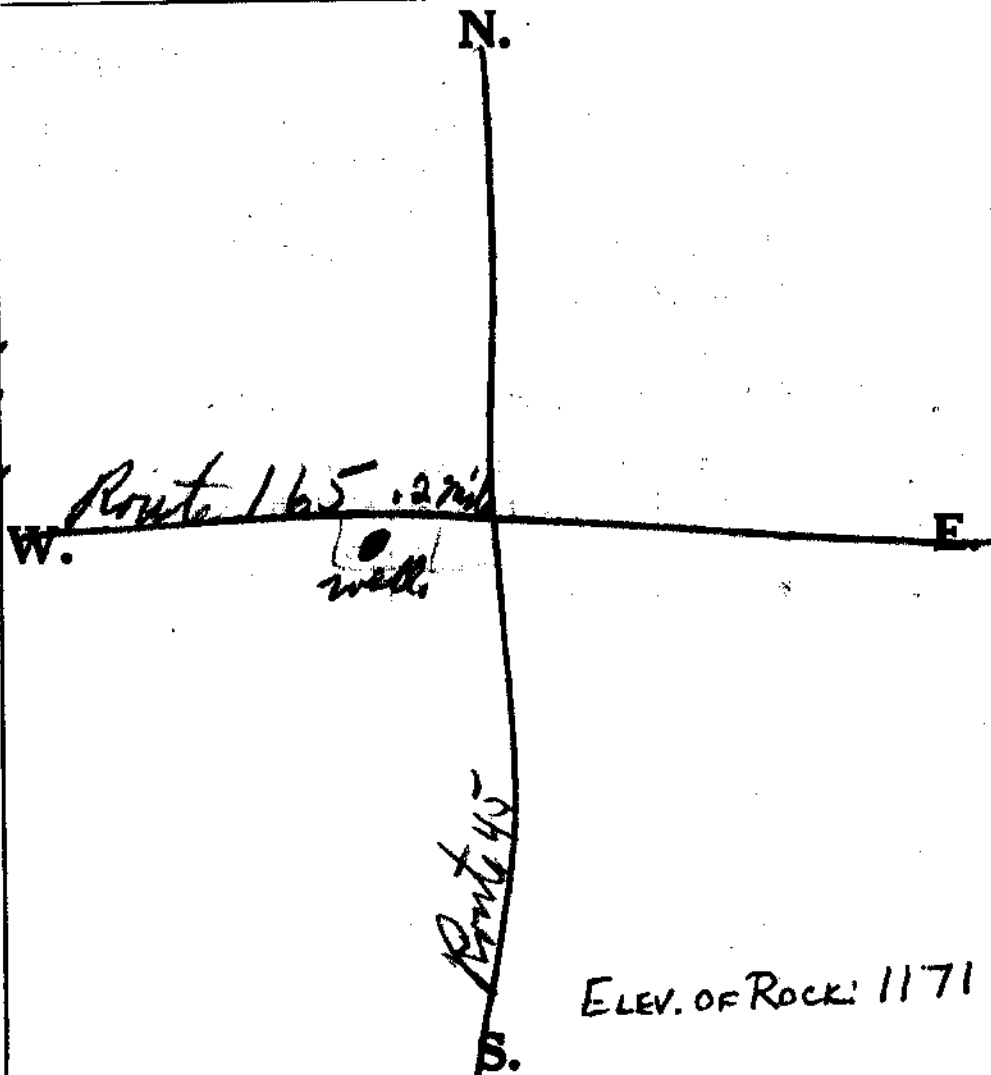

See reverse side for instructions

Drilling Firm L.D. Chingman Date August 25 1964
Address R. 2, D. # 4 Salem Ohio Signed Lester D. Chingman