

ORIGINAL

Nº 345043

**Division of Water
1562 W. First Avenue
Columbus, Ohio 43212**

County Deane Township Chester Section of Township W
Owner Frank Danante Address Asolo Dr. Chesterland
Location of property 3/4 157 Spring Blossom Trail

CONSTRUCTION DETAILS

Casing diameter 600' Length of casing 58'
Type of screen — Length of screen —
Type of pump Sub
Capacity of pump 8 GPM
Depth of pump setting 140'
Date of completion 9-1-66

BAILING OR PUMPING TEST

Pumping Rate 12 G.P.M. Duration of test 2 hrs.
Drawdown 10 ft. Date 7-30-62
Static level-depth to water 95 ft.
Quality (clear, cloudy, taste, odor) Clear
Pump installed by Wm W. [Signature]


WELL LOG*

[illegible]

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

N.

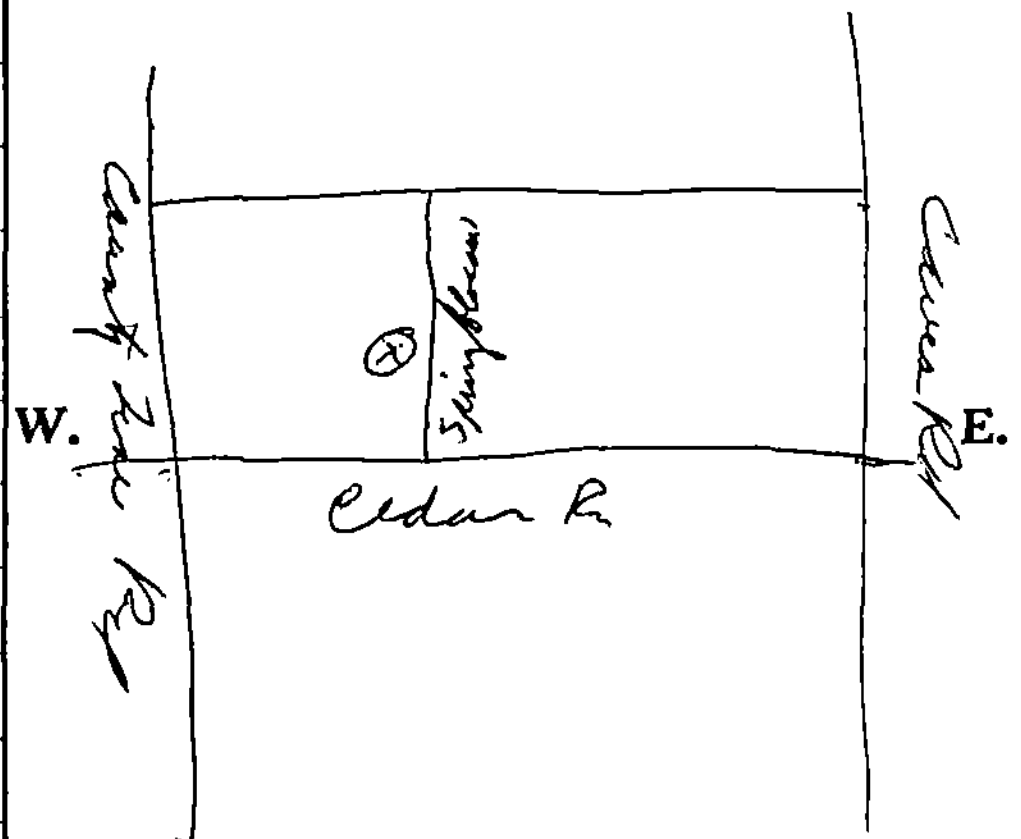

S.

See reverse side for instructions

Drilling Firm *1389 Whiting*
Address *12180 Chulucot St*

Date 9-1-65
Signed Wm W. Butler

*If additional space is needed to complete well log, use next consecutive numbered form.