

ORIGINAL

Nº 358263

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
1562 W. First Avenue
Columbus, Ohio 43212

County Hamilton Township Crosby Section of Township _____

Owner Mobil Chemical Corporation Address Paddys Run Rd., Fernald, Ohio.

Location of property On Paddys Run Rd. north of New Haven Rd.

CONSTRUCTION DETAILS

Casing diameter 12" Length of casing 62 Ft.

Type of screen Cook WW Length of screen 20 Ft.

Type of pump... Peerless Turbine

Capacity of pump 225 GPM at 240 TDH.

Depth of pump setting.....75 Ft.

Date of completion Jan. 7, 1970

BAILING OR PUMPING TEST

Pumping Rate 395 G.P.M. Duration of test 6 hrs.

Drawdown 7 ft. Date Jan. 7, 1970

Static level-depth to water 10 ft.

Quality (clear, cloudy, taste, odor) Clear

Pump installed by J.S. B. Koehne

WELL LOG*

Formations
Sandstone, shale, limestone,
gravel and clay

From

To

Top soil	0 Feet	7 Ft.
----------	--------	-------

Dry yellow muddy sand	7	18
-----------------------	---	----

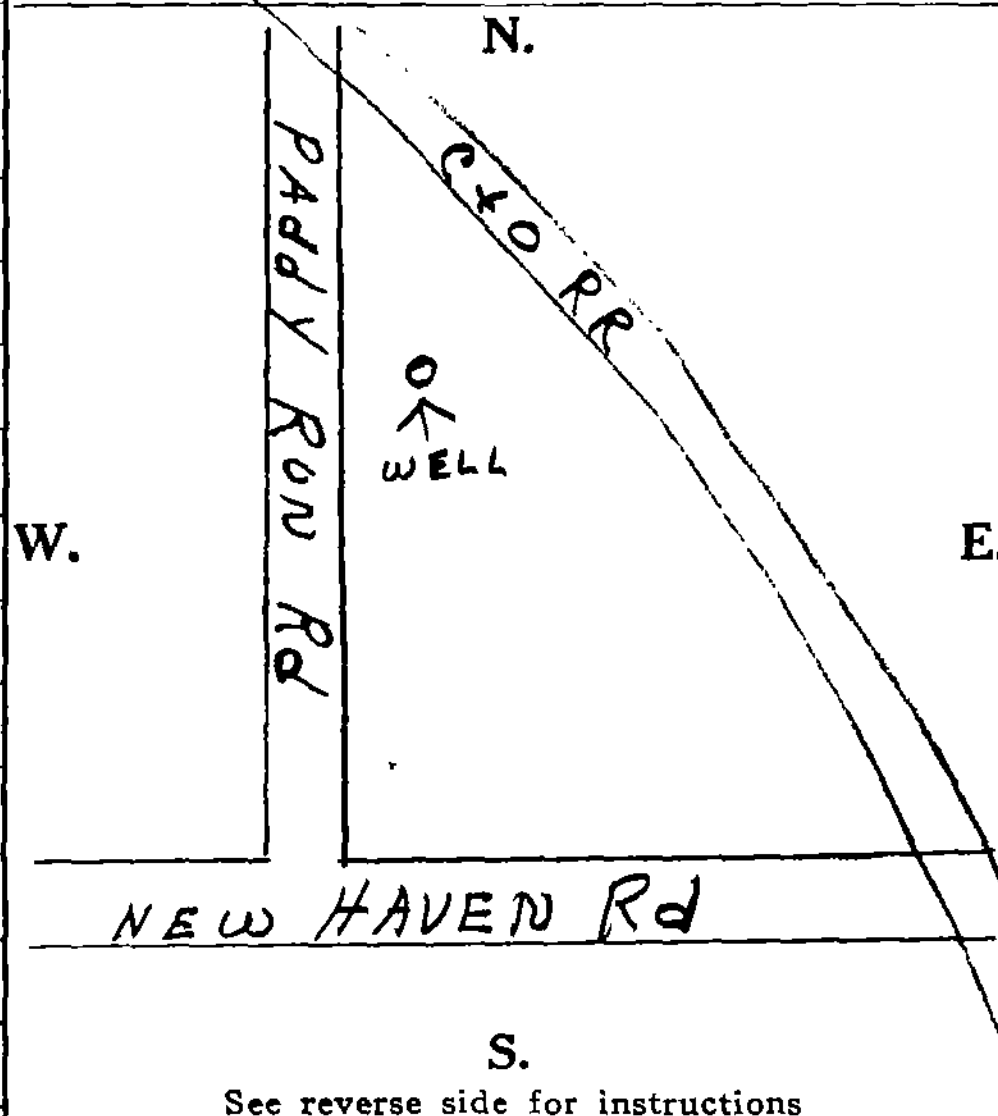
Yellow sand & gravel	18	47
----------------------	----	----

Grey fine sand	47	52
----------------	----	----

Grey sand & gravel	52	83
--------------------	----	----

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

Drilling Firm Jos. B. Koehne

Date Jan. 8, 1970

Address 7028 Moorfield Dr. Cinti. 45230

Signed Joe. B. Drake

*If additional space is needed to complete well log, use next consecutive numbered form.