

ORIGINAL

Nº 364992

Division of Water
1562 W. First Avenue
Columbus, Ohio 43212

County Cuyahoga Township Strongsville Section of Township _____

Owner Fred E. Gedeon Address 14409 Mill Hollow Lane

Location of property 14409 Mill Hollow Lane

CONSTRUCTION DETAILS

Casing diameter 5 1/2 Length of casing 108'

Type of screen.....Length of screen.....

Type of pump Sub

Capacity of pump.....8 GPM.

Depth of pump setting.....147'

Date of completion 8/22/68

BAILING OR PUMPING TEST

Pumping Rate 10 G.P.M. Duration of test 2 hrs.

Drawdown 35 ft. Date 8/22/68

Static level-depth to water.....65.....ft.

Quality (clear, cloudy, taste, odor).....


Pump installed by Schneider

WELL LOG*

[illegible]

SKETCH SHOWING LOCATION

Locate in reference to numbered
State Highways, St. Intersections, County roads, etc.

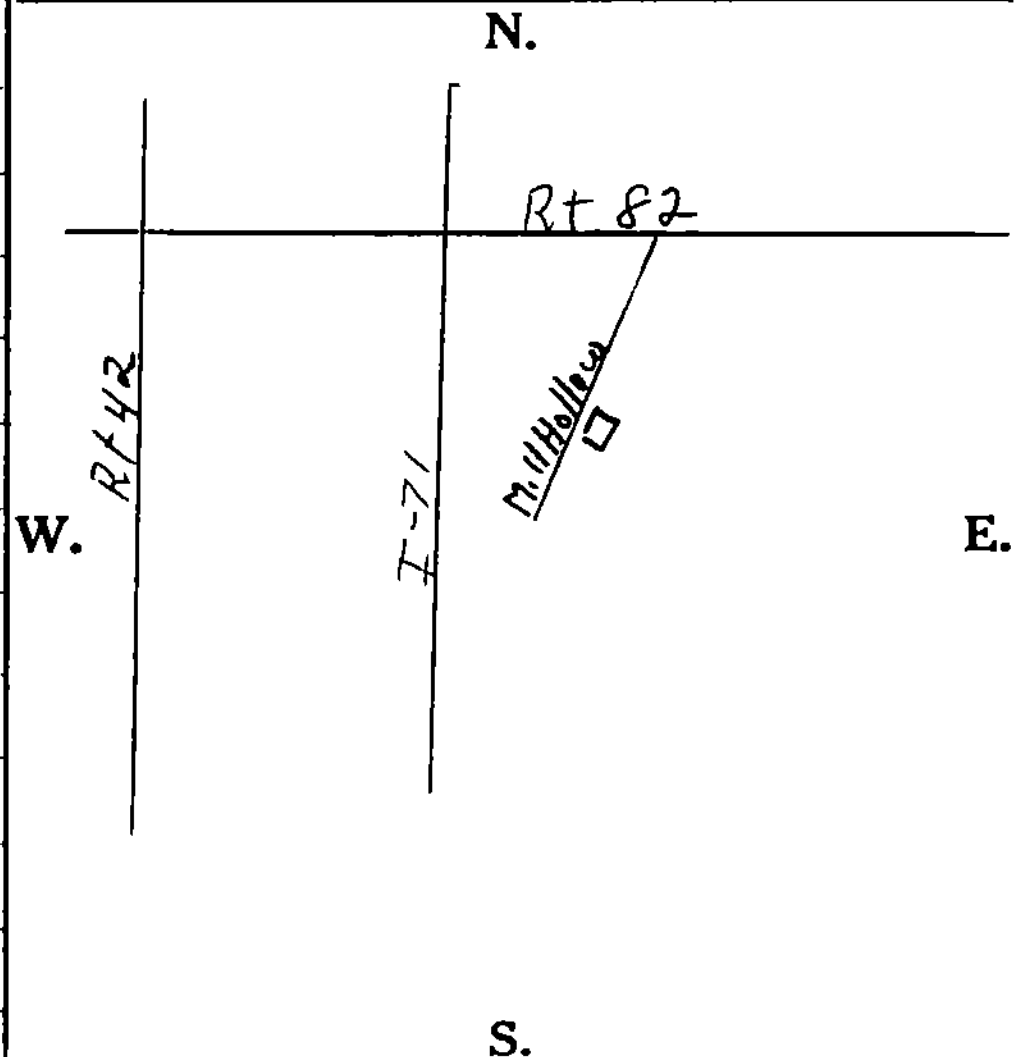

See reverse side for instructions

Drilling Firm Schneider Well Drilling Inc.
13690 West 130th Street
Address Strongsville 36, Ohio

Date 8/22/68

Signed Ronald Schneider

*If additional space is needed to complete well log, use next consecutive numbered form.