

WELL LOG AND DRILLING REPORT

ORIGINAL

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

528267

COUNTY LAKE TOWNSHIP LEROY SECTION OF TOWNSHIP _____
OWNER JAMES BINN ADDRESS 6132 PAINE RD, PAINESVILLE, OHIO
LOCATION OF PROPERTY 6132 PAINE RD, LEROY TWP.

CONSTRUCTION DETAILS

Casing diameter 6" O.D. Length of casing 20'
Type of screen _____ Length of screen _____
Type of pump _____
Capacity of pump _____
Depth of pump setting _____
Date of completion _____

BAILING OR PUMPING TEST (specify one by circling)


Test rate 20 gpm Duration of test 1 hrs
Drawdown 12 ft Date 12-12-78
Static level (depth to water) 12'-06" ft
Quality (clear, cloudy, taste, odor) SULFUR ODOR
Pump installed by _____

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
<u>YELLOW CLAY</u>	<u>0 ft</u>	<u>8 ft</u>
<u>GRAY SHALE</u>	<u>8</u>	<u>20</u>
<u>GRAY SHALE - SILICEOUS LAYERS</u>	<u>20</u>	<u>52</u>

SKETCH SHOWING LOCATION

Locate in reference to numbered
state highways, street intersections, county roads, etc.

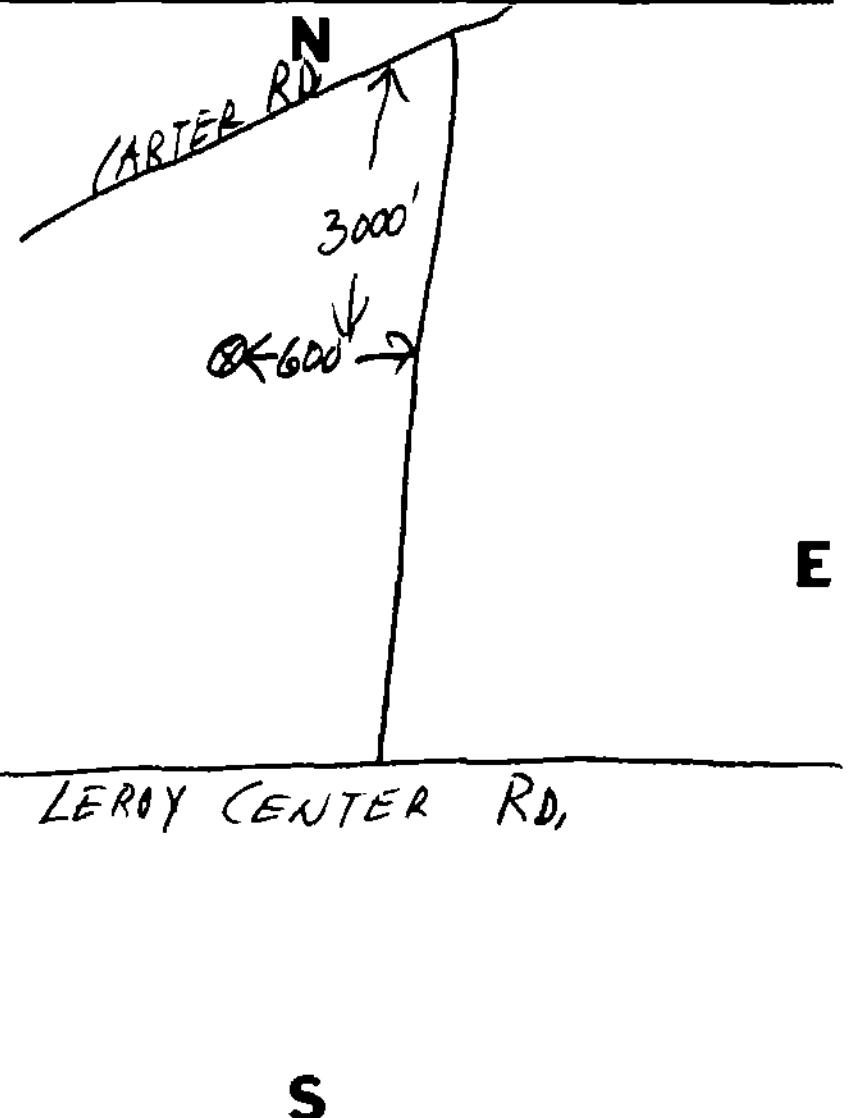

DRILLING FIRM HARRY NERODA
ADDRESS 51 ADELAIDE AVE.
PAINESVILLE, OHIO

DATE 12-13-78
SIGNED Harry Neroda

*If additional space is needed to complete well log, use next consecutive numbered form.