

WELL LOG AND DRILLING REPORT

ORIGINAL

66

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

528638

COUNTY PREBLE TOWNSHIP TWIN SECTION OF TOWNSHIP 18
OWNER CHUCK LEEDY ADDRESS R.R. #1 EATON, OHIO
LOCATION OF PROPERTY S/E Side of Eaton Lewisburg Rd. 1/2 mi. N. Minnick Wysocky Rd.

CONSTRUCTION DETAILS

Casing diameter 6" Length of casing 48'
Type of screen NONE Length of screen —
Type of pump SUBMERISIBLE
Capacity of pump 1/2 H.P. 13 GPM
Depth of pump setting 49'
Date of completion 12-27-80

BAILING OR PUMPING TEST

(specify one by circling)


Test rate 14-25 gpm Duration of test 4 hrs
Drawdown 4 1/2 ft Date 12-23-80
Static level (depth to water) 17' ft
Quality (clear, cloudy, taste, odor) CLEAR + MIGHTY TASTY
Pump installed by PAXTONS WELL DRILLING & PUMP Ser.

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
<u>YELLOW CLAY</u>	0 ft	11 ft
<u>BLUE CLAY</u>	11	46
<u>SANDSTONE ROCK</u>	46	50

SKETCH SHOWING LOCATION

Locate in reference to numbered state highways, street intersections, county roads, etc.

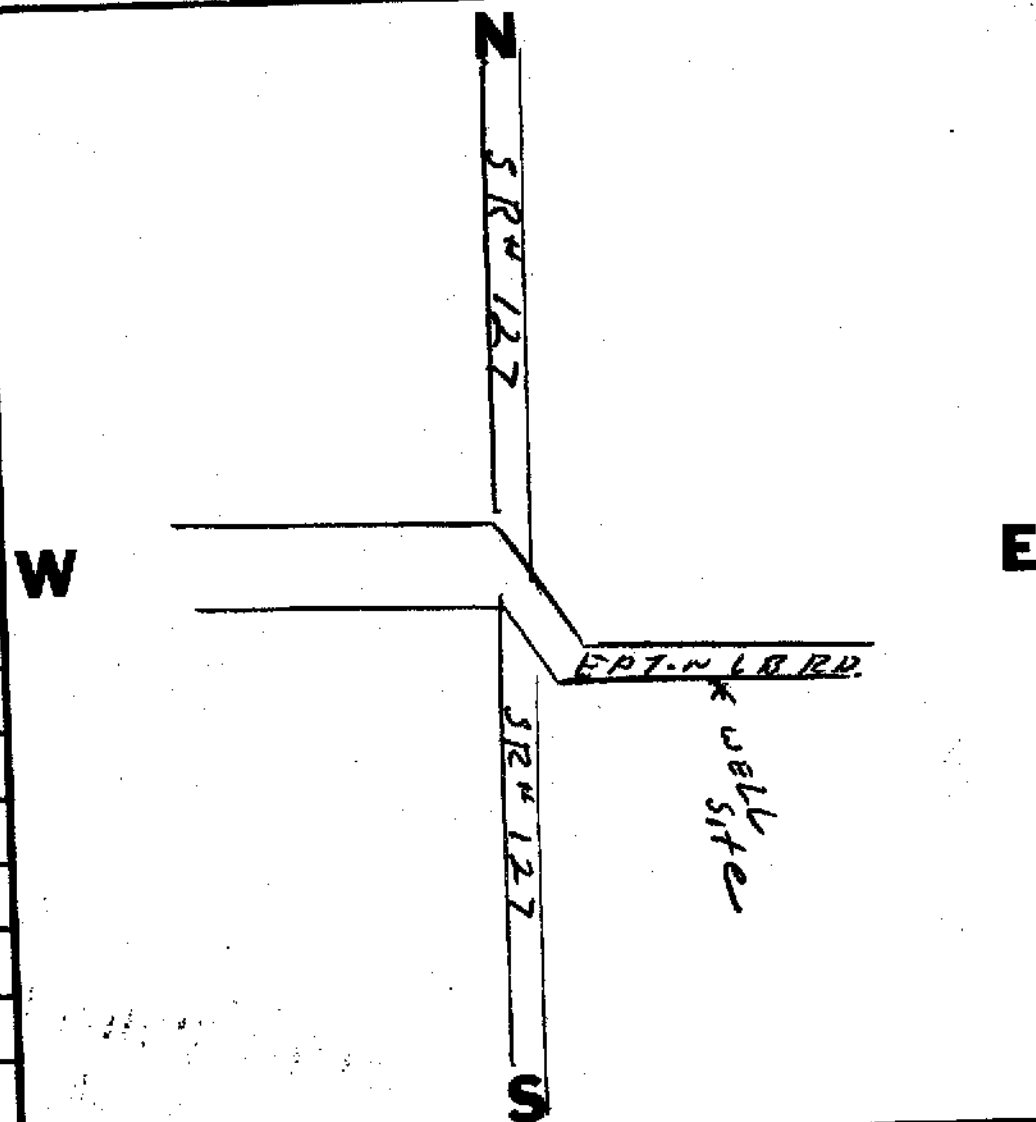

DAVID C. BARNES D.R.A.
DRILLING FIRM PAXTONS WELL DRILLING & PUMP DATE 12-23-80
ADDRESS 3004 Ridge Dr. Greenville, O. SIGNED David C. Barnes

*If additional space is needed to complete well log, use next consecutive numbered form.