County Permit No.
84-110

NO CARBON PAPER NECESSARY– SELF-TRANSCRIBING

WELL LOG AND DRILLING REPORT

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

531164

COUNTY Licking TOWNSHIP Washington SECTION OF TOWNSHIP N.E. Washington Twp

OWNER Jack Londot ADDRESS 11285 Martinsburg Rd Utica O.

LOCATION OF PROPERTY

CONSTRUCTION DETAILS

Casing diameter 5" Length of casing 126

Type of screen Length of screen

Type of pump 3/4 subm.

Capacity of pump 12 gpm

Depth of pump setting 146

Date of completion 7-21-84

BAILING OR PUMPING TEST
(specify one by circling)

Test rate 12 gpm Duration of test 8 hrs

Drawdown 8' [redacted] ft Date 7-20-84

Static level (depth to water) 117 ft

Quality (clear, cloudy, taste, odor) clear - [redacted] odor -less.

Pump installed by Gary Wheeler

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
topsoil	0 ft	2 ft
clay & sand	2	17
gray shale crevace	17	18
brown shale	18	46
gray shale	46	105
brown sandrock	105	130
yellow sandrock	130	162'

SKETCH SHOWING LOCATION

Locate in reference to numbered state highways, street intersections, county roads, etc.

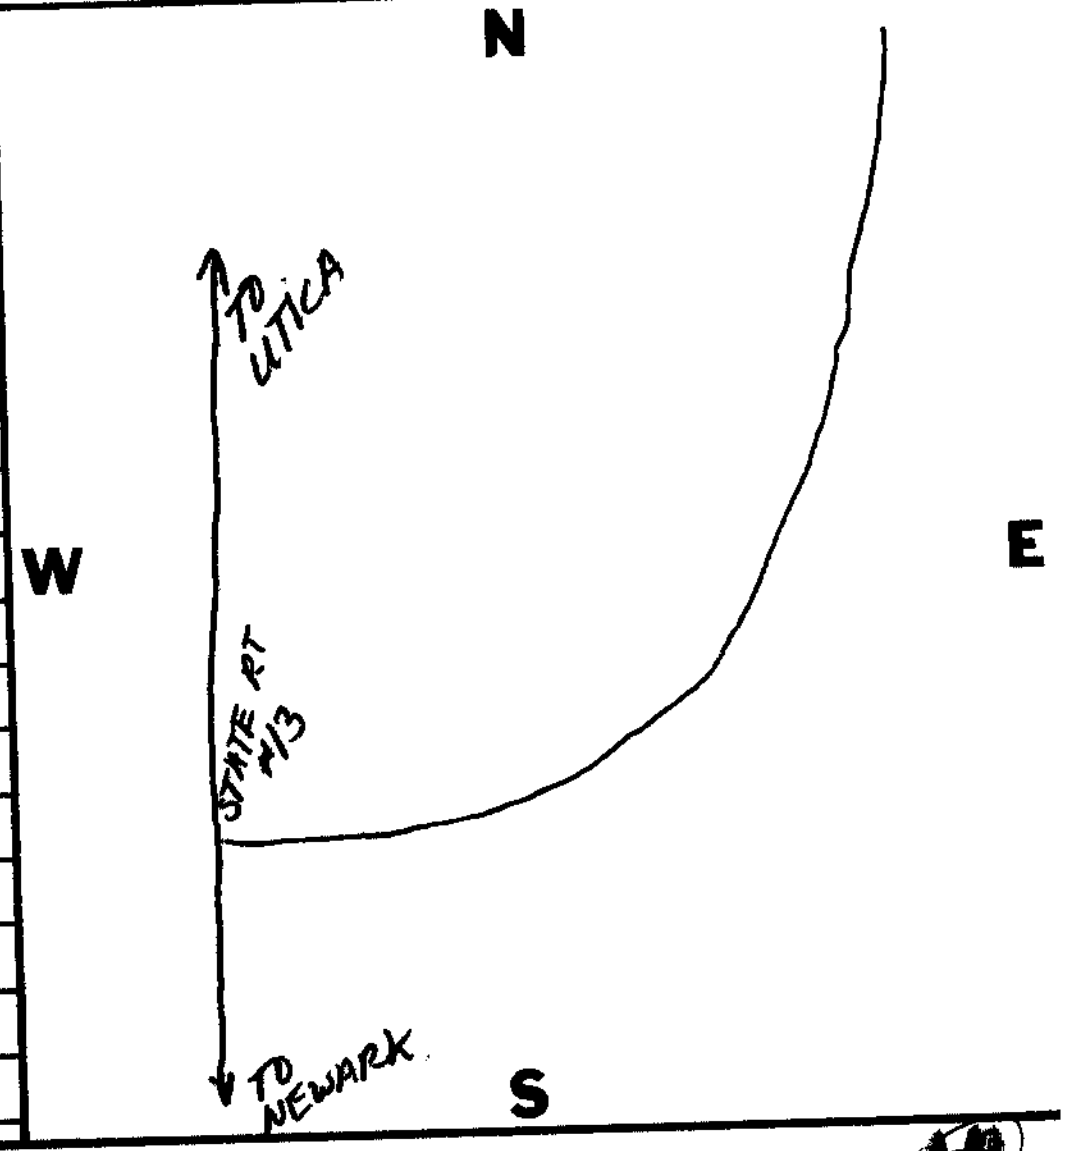

DRILLING FIRM Wheeler Water Well Drilling DATE 7-23-84

ADDRESS 242 Merchant St. Newark O SIGNED Gary Wheeler #856

86

*If additional space is needed to complete well log, use next consecutive numbered form.