

County Permit No. _____

WELL LOG AND DRILLING REPORT

ORIGINAL

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBINGState of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

534352

COUNTY Hamilton TOWNSHIP Village of Elmwood SECTION OF TOWNSHIP _____
 OWNER Xtek Inc. ADDRESS 211 Township Ave., Cincinnati, Ohio 45216
 LOCATION OF PROPERTY 211 Township Ave., Cincinnati, Ohio 45216

CONSTRUCTION DETAILS**BAILING OR PUMPING TEST**

(specify one by circling)

Casing diameter 8" Length of casing 135 Ft.
 Type of screen 304 Stainless Length of screen 16' 4"
 Type of pump Webtrol Submersible
 Capacity of pump 225 GPM
 Depth of pump setting 135 Ft.
 Date of completion Feb. 20, 1980

Test rate 225 gpm Duration of test 3 hrs
 Drawdown 20 ft Date Feb. 20, 1980
 Static level (depth to water) 80 ft
 Quality (clear, cloudy, taste, odor) Clear
 Pump installed by Jos. B. Koehne


WELL LOG***SKETCH SHOWING LOCATION**Formations: sandstone, shale,
limestone, gravel, clay

From

To

Locate in reference to numbered
state highways, street intersections, county roads, etc.

Top soil	0 ft	5 ft
Muddy sand, little water	5	22
Blue Clay	22	65
Dry brown muddy sand	65	87
Muddy sand	87	103
Brown sand	103	108
Coarse Gray sand	108	112
Coarse sand & gravel	112	133
Fine sand	133	136
Coarse gravel	136	137
Fine sand	137	146'6"
Coarse sand & gravel	146'6"	150
Clay - Blue		

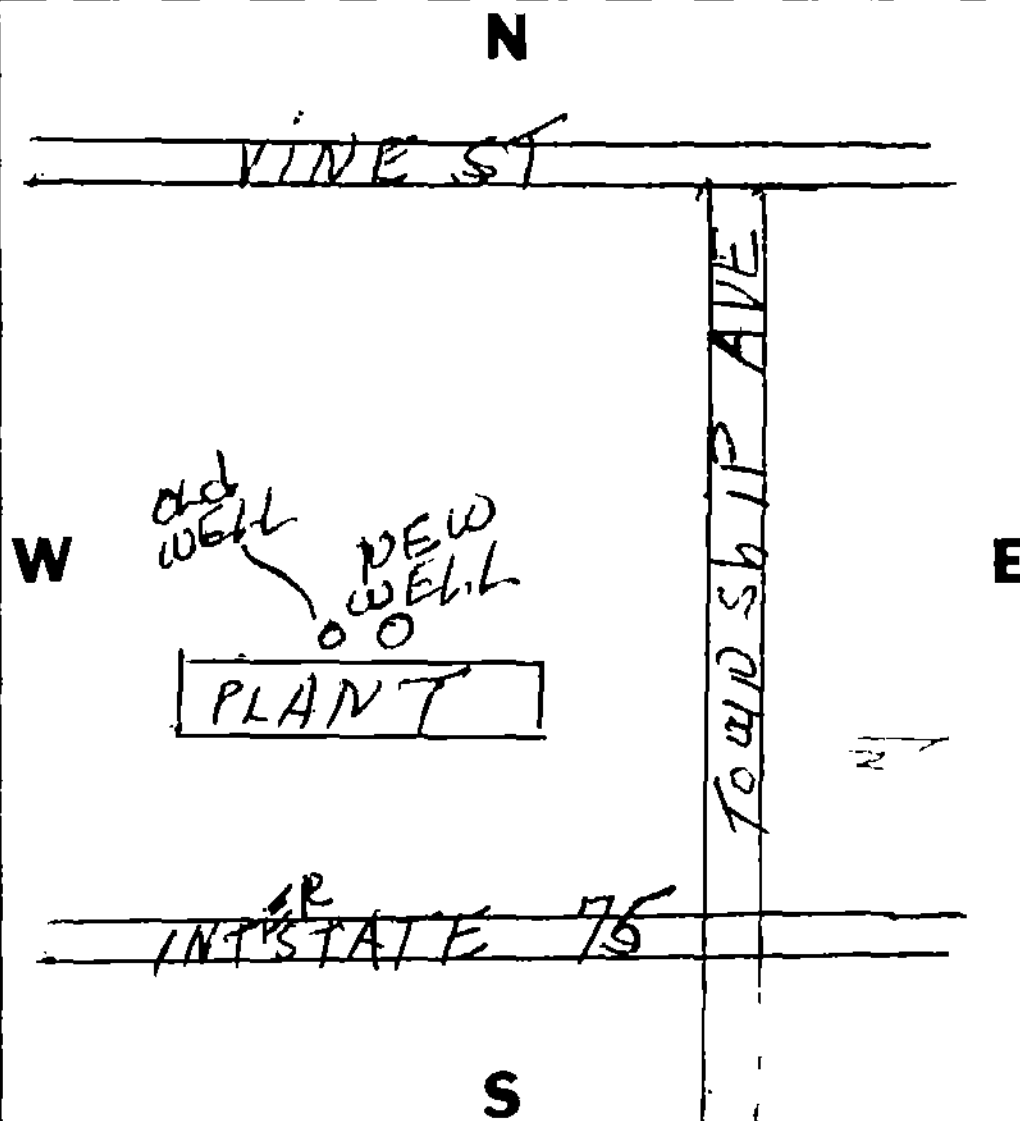

Howard Smith screen - SS 304
 Top 10 ft. slot No. 16
 bottom 5 ft. slot No. 30.

DRILLING FIRM Jos. B. Koehne
 ADDRESS 7028 Moorfield Dr., Cinti., Ohio

DATE Feb. 27, 1980SIGNED Jos. B. Koehne

*If additional space is needed to complete well log, use next consecutive numbered form.