

County Permit No. _____

WELL LOG AND DRILLING REPORT

ORIGINAL

NO CARBON PAPER
NECESSARY—
SELF-TRANSCRIBINGState of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

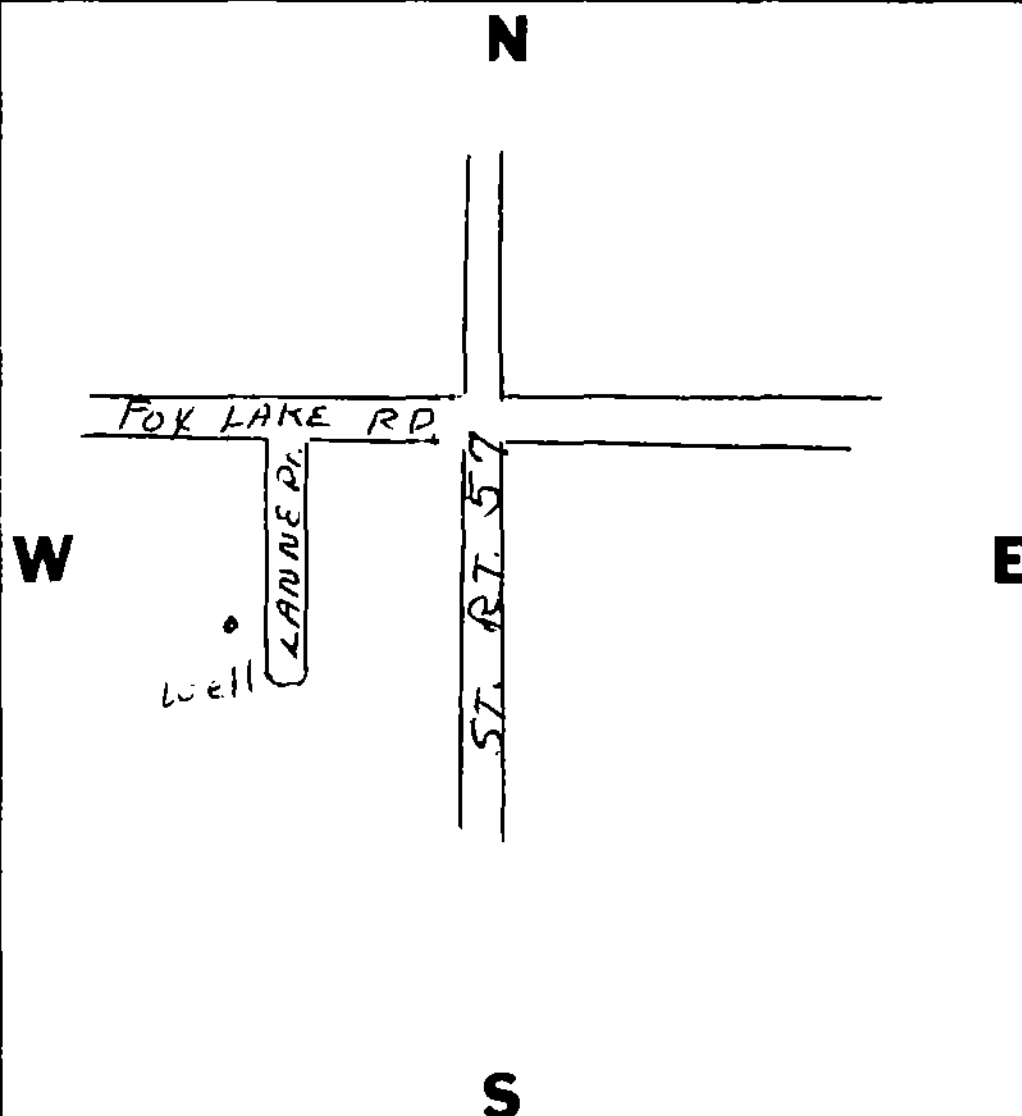
548658

COUNTY Wayne TOWNSHIP Green SECTION OF TOWNSHIP 12
OWNER Steve Miller ADDRESS 9643 W. High St., Orrville, OhioLOCATION OF PROPERTY South of Fox Lake Rd. on the west side of Lanne Dr.**CONSTRUCTION DETAILS**Casing diameter 5" Length of casing 94' 5"
Type of screen _____ Length of screen _____
Type of pump Webtrol - sub.
Capacity of pump _____
Depth of pump setting 70'
Date of completion 5/15/78**BAILING OR PUMPING TEST**

(specify one by circling)

Test rate 10 gpm Duration of test 1 hrs
Drawdown 15 ft Date 5/3/78
Static level (depth to water) 41 ft
Quality (clear, cloudy, taste, odor) Clear
Pump installed by A-1 Water Service**WELL LOG***

Formations: sandstone, shale, limestone, gravel, clay	From	To
Top soil	0 ft	2 ft
Yellow clay	2	20
Sand & gravel	20	42
Gray clay	42	55
Gravel	55	69
Clay	69	91
Gray shale	91	110
Gray sandy shale	110	115
Gray shale	115	120

SKETCH SHOWING LOCATIONLocate in reference to numbered
state highways, street intersections, county roads, etc.DRILLING FIRM A-1 Water Service
ADDRESS 2425 Old Lincoln Way West
Wooster, OhioDATE Oct. 3, 1978
SIGNED D. Pallard

*If additional space is needed to complete well log, use next consecutive numbered form.

(14) A