

NO CARBON PAPER
NECESSARY-
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

COUNTY Putnam TOWNSHIP Monroe SECTION OF TOWNSHIP 23
OWNER Rob Howell ADDRESS Rt 1 Continental, Ohio
LOCATION OF PROPERTY 634 No to Rd E East - 1 mi N side of road

CONSTRUCTION DETAILS

BAILING OR PUMPING TEST
(specify one by circling)

(specify one by circling)

Casing diameter 5 5/8" Length of casing 54'

Test rate 10 gpm Duration of test 1 hrs

Type of screen _____ Length of screen _____

Drawdown _____ ft Date 8-9-82

Type of pump _____

Static level (depth to water) _____ 31 _____ ft

Capacity of pump _____

Quality (clear, cloudy, taste, odor) clear

Depth of pump setting _____

Pump installed by _____

WELL LOG*

SKETCH SHOWING LOCATION

Formations: sandstone, shale,
limestone, gravel, clay

From

To

Locate in reference to numbered
state highways, street intersections, county roads, etc.

slau	0 ft	54 ft
------	------	-------


0 ft

54 ft

limestone	54'	64'
-----------	-----	-----

54'

64'

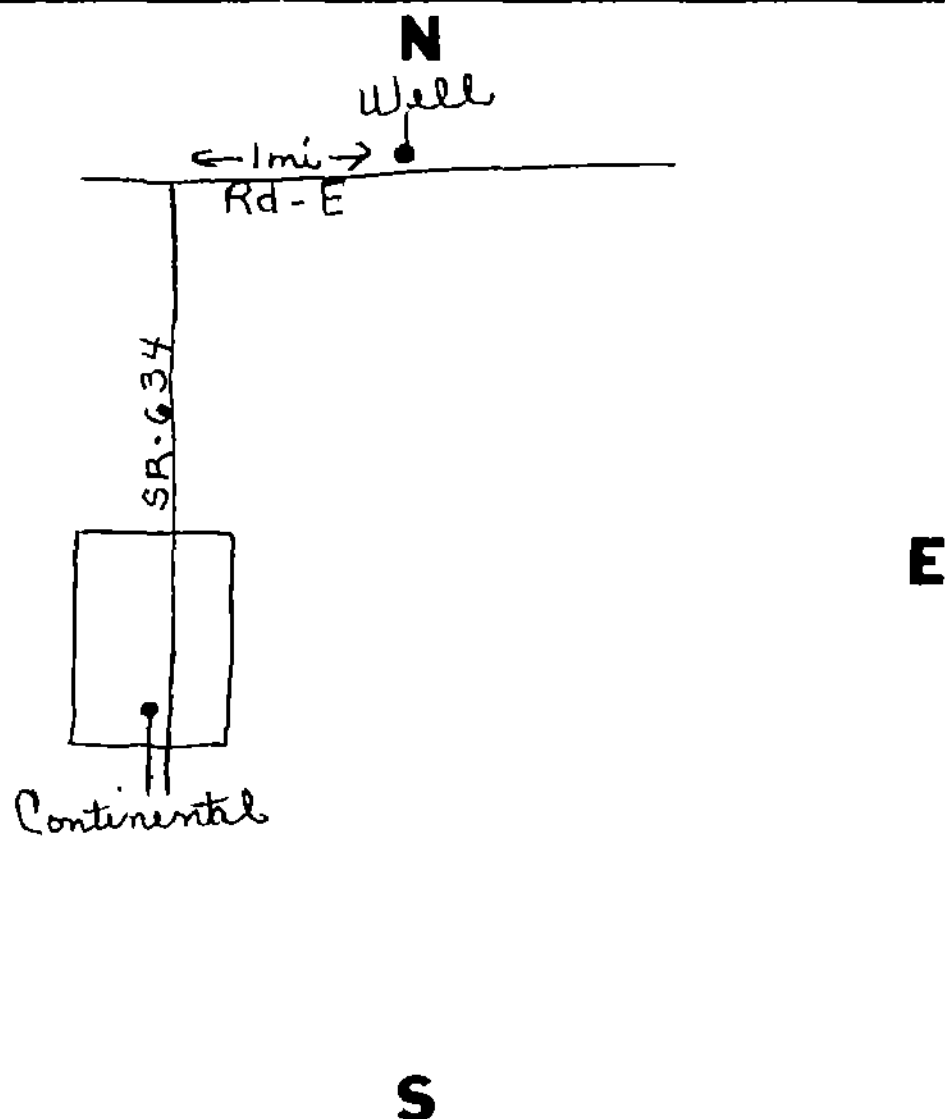

DRILLING FIRM Stauffer Drilling Co
ADDRESS R4 Ottawa, Ohio 445875

DATE 8-9-82
SIGNED John Stoppel by JTE

*If additional space is needed to complete well log, use next consecutive numbered form.

ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224

34