

WELL LOG AND DRILLING REPORT

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

612209

COUNTY FULTON TOWNSHIP XORK SECTION OF TOWNSHIP 19
OWNER CHRISTOPHER SNYDER ADDRESS 12540-E, WANSEON, OH
LOCATION OF PROPERTY CO. RD. E LOT 5 EDGENHILL-ADDITION

CONSTRUCTION DETAILS

Casing diameter 4" Length of casing 155
Type of screen - Length of screen -
Type of pump SUBMERSIBLE
Capacity of pump 6 G.P.M.
Depth of pump setting 105'
Date of completion 4-19-'86

BAILING OR PUMPING TEST

(specify one by circling)


Test rate 8 gpm Duration of test 1 hrs
Drawdown 10 ft Date 4-17-86
Static level (depth to water) 65' ft
Quality (clear, cloudy, taste, odor) CLEAR
Pump installed by DRILLER

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
TOP SOIL	0 ft	1 ft
YELLOW SAND	1	7
GRAY CLAY	7	102
HARD PAN	102	104
GRAY CLAY	104	125
GRAY CLAY & STONES	125	145
GRAY CLAY	145	152
BLK GRAVEL & SAND	152	155
BLACK O. SHALE	155	160
WATER AT 159		

SKETCH SHOWING LOCATION

Locate in reference to numbered
state highways, street intersections, county roads, etc.

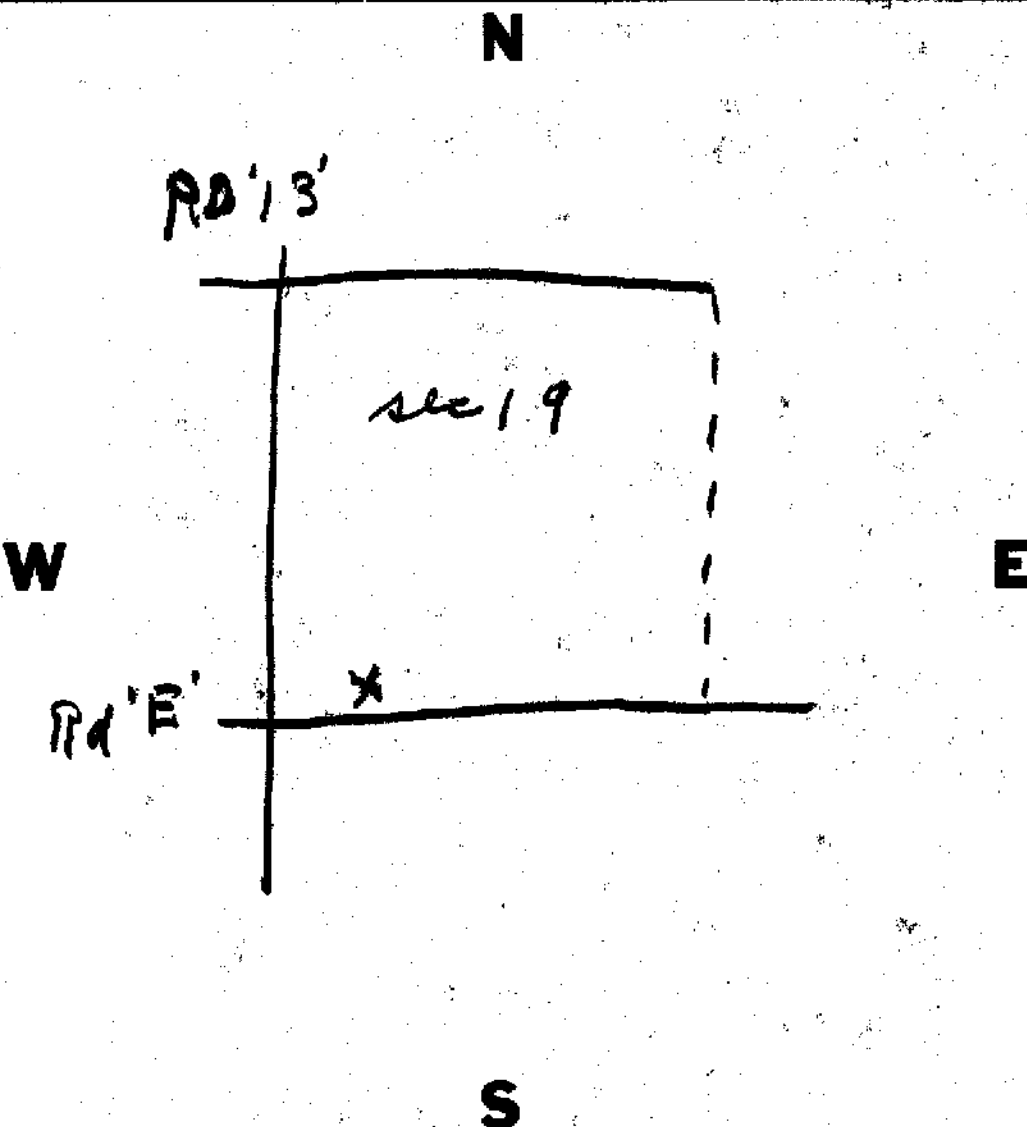

DRILLING FIRM BYRON SHAFFER
ADDRESS WANSEON, OH

DATE 4-19-86
SIGNED Byron Shaffer

*If additional space is needed to complete well log, use next consecutive numbered form.

ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224

30