

WELL LOG AND DRILLING REPORT

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

618666
Well #2

COUNTY MADISON TOWNSHIP Deer Creek SECTION OF TOWNSHIP N.E.
OWNER Ben E. Tobin Monogram Motel ADDRESS SR 42 Rt 3 London, Ohio 43140
LOCATION OF PROPERTY West Side Rt 42 South of 76 Truck Stop

CONSTRUCTION DETAILS

Casing diameter 6" I.D. 5th Length of casing 111'
Type of screen _____ Length of screen NONE
Type of pump Test Pump
Capacity of pump 100 GPM
Depth of pump setting 104'
Date of completion 7-24-86

BAILING OR PUMPING TEST (specify one by circling)


Test rate 50.7 gpm Duration of test 24 hrs
Drawdown 47'4" ft Date _____
Static level (depth to water) 27'9" ft
Quality (clear, cloudy, taste, odor) Clear
229 PPM Hard 1.5 Iron 7.1 P.H.
Pump installed by WATER SYSTEMS INC

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
<u>Yellow CLAY</u>	<u>0 ft</u>	<u>30 ft</u>
<u>Hard Pan + Gravel</u>	<u>30'</u>	<u>50'</u>
<u>Dry SAND</u>	<u>50'</u>	<u>59'</u>
<u>Hard Pan</u>	<u>59'</u>	<u>89'</u>
<u>Broken Rock</u>	<u>89'</u>	<u>111'</u>
<u>Limestone</u>	<u>111'</u>	<u>192'</u>
Well #1 Log 651001 Pumped		
AT 20 gpm at same time		
Well #2 Pumped AT 50.7		
24 hours,		
Well #2 Located 50'		
S.W. Well #1 Well Log		
# 651001		

SKETCH SHOWING LOCATION

Locate in reference to numbered
state highways, street intersections, county roads, etc.

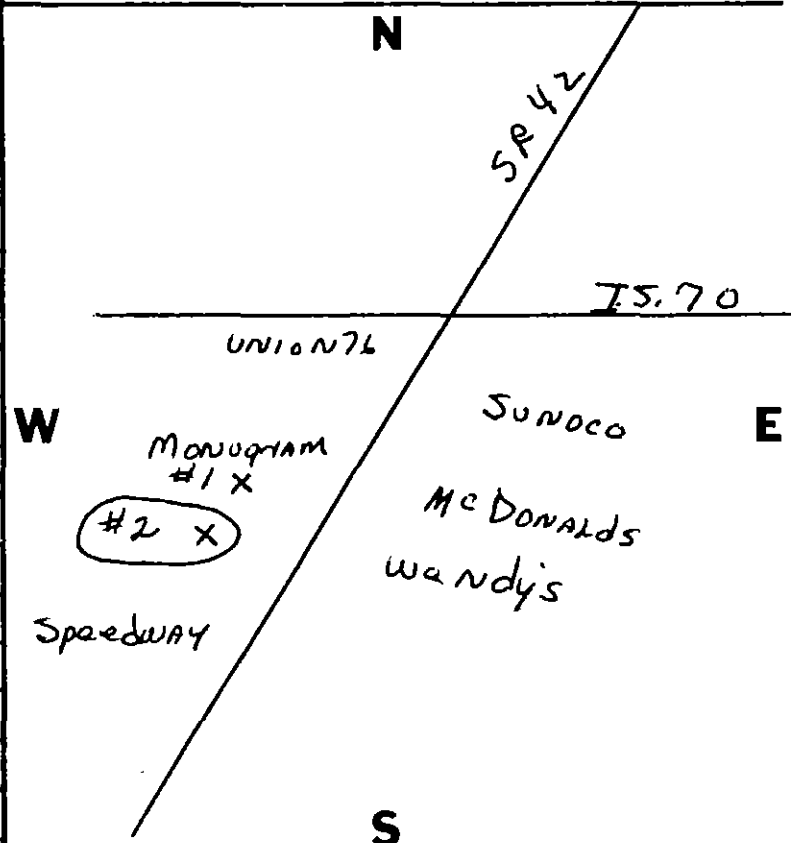

DRILLING FIRM WATER SYSTEMS INC DATE July 24, 1986
ADDRESS My. Vannoy, Ohio 1-614-3975278 SIGNED William Pullins T.L. Underhill

*If additional space is needed to complete well log, use next consecutive numbered form.

ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224

Well Test

6186 Lab


MonogramMotelOrifice MethodJuly 24, 19863" Pipe x 1 3/4"ORIFICE 1 3/4"ON Well #2Top of Casing Well #246" above ground levelTop of CasingWell #1 36" Above ground levelWell #1Pumped AT ConstantRate of 20 G.P.M.24 hoursWell #2Pumped IN EXCESSof 50 G.P.M.24 hours

Me Time	Well #1 WATER LEVEL	Pumping Rate #1	Well #2 WATER LEVEL	Reading of Monometer	Gallon Per Minute	Return to STATIC
00	25' 10"	Set AT 20 G.P.M.	27' 9"	0"	50.0	Well #1 Well #2
30	31' 9"	20 G.P.M.	45' 0"	20"	50.7	3hr - 1hr30
30	32' 8"		71' 10"	23"	54.0	
30	32' 10"		71' 10"	20"	50.7	
30	32' 9"		71' 11"	20"	50.7	
30	32' 9"		71' 11"	20"	50.7	
30	32' 11"		73' 7"	20"	50.7	
30	33' 0"		73' 11"	20"	50.7	
30	33' 0"		73' 11"	20"	50.7	
30	33' 1"		74' 3"	20"	50.7	
30	33' 2"		75' 0"	20"	50.7	
30	33' 2"		75' 1"	20"	50.7	
30	32' 11"		75' 0"	20"	50.7	
30	32' 7"		75' 4"	20"	50.7	
30	33' 7"		75' 7"	20"	50.7	
30	33' 8"		75' 8"	20"	50.7	
30	33' 7"		75' 8"	20"	50.7	
30	33' 7"		75' 8"	20"	50.7	
30	33' 7"		75' 8"	20"	50.7	
30	33' 7"		75' 9"	20"	50.7	
30	33' 7"		75' 8"	20"	50.7	
30	33' 7"		75' 7"	20"	50.7	
30	33' 7"		75' 7"	20"	50.7	
30	33' 8"		75' 3"	20"	50.7	
30	33' 8"		75' 3"	20"	50.7	
30	33' 8"		75' 3"	20"	50.7	

6018660

24 Hour Test Information

APPROX. TIME

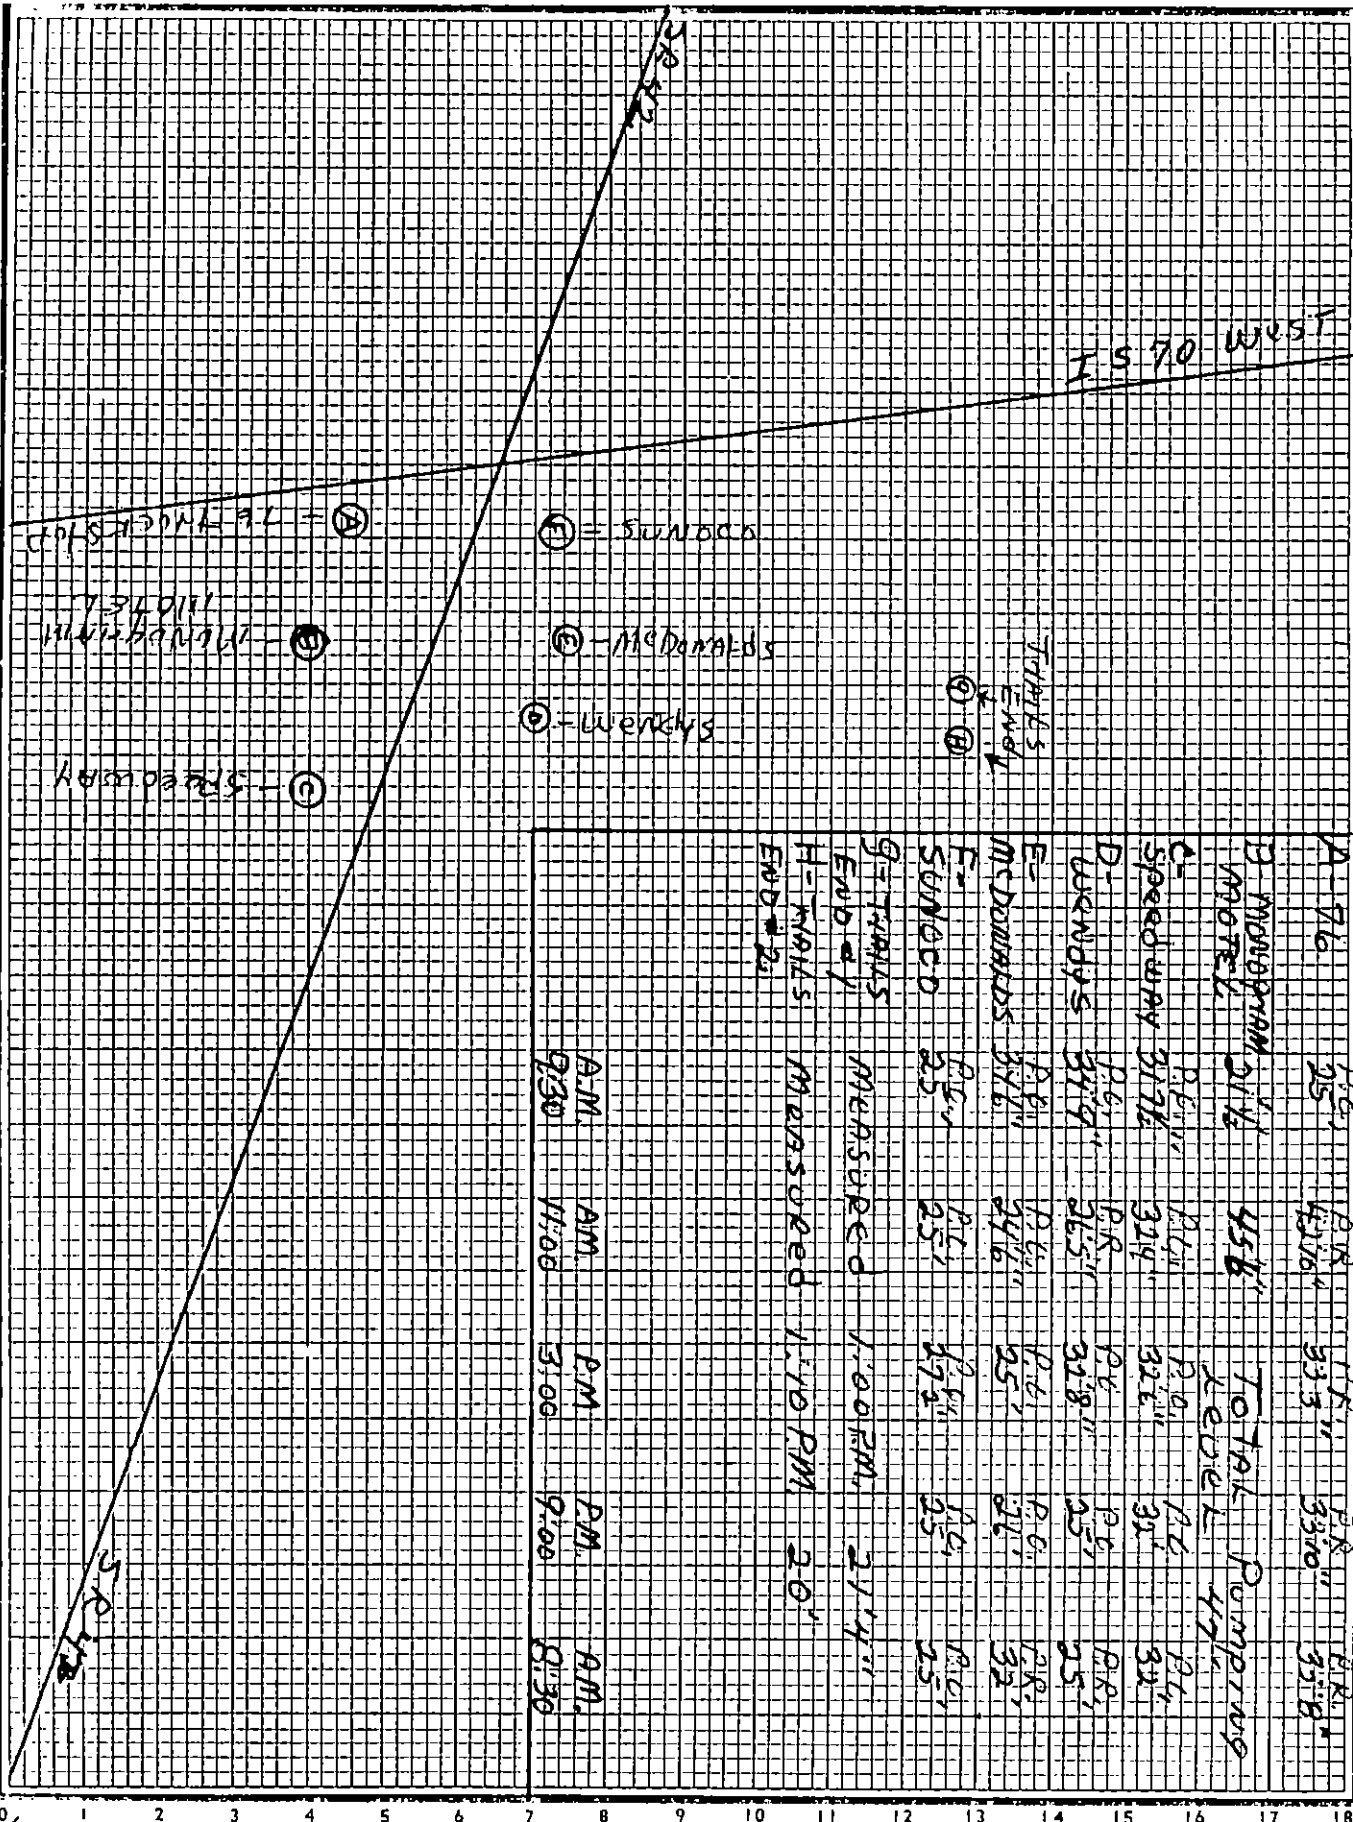

June 26th 27th 1956

WATER SYSTEMS INC

See Well #1

651001

also
rest
sheet