

WELL LOG AND DRILLING REPORT

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

643347

COUNTY PICKAWAY TOWNSHIP CIR SECTION OF TOWNSHIP _____
OWNER JOHN BOWERS ADDRESS 24266 RINGOLD SOUTHERN RD
LOCATION OF PROPERTY 20353 ISLAND RD

CONSTRUCTION DETAILS

Casing diameter 5 1/2 Length of casing 91
Type of screen P.P. Length of screen 4 FT
Type of pump SUB - DURO
Capacity of pump 12 G.P.M.
Depth of pump setting 80 FT
Date of completion 8/24/90

BAILING OR PUMPING TEST (specify one by circling)


Test rate 18 gpm Duration of test 2 hrs
Drawdown 60 ft Date 7/20/90
Static level (depth to water) 54 ft
Quality (clear, cloudy, taste, odor) CLEAR
Pump installed by D.L. WHITESED

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
<u>TS</u>	<u>0 ft</u>	<u>2 ft</u>
<u>DRY SAND GRAVEL</u>	<u>2</u>	<u>28</u>
<u>CLAY</u>	<u>28</u>	<u>42</u>
<u>SAND + GRAVEL</u>	<u>42</u>	<u>64</u>
<u>CLAY</u>	<u>64</u>	<u>82</u>
<u>SAND + GRAVEL</u>	<u>82</u>	<u>91</u>

SKETCH SHOWING LOCATION

Locate in reference to numbered
state highways, street intersections, county roads, etc.

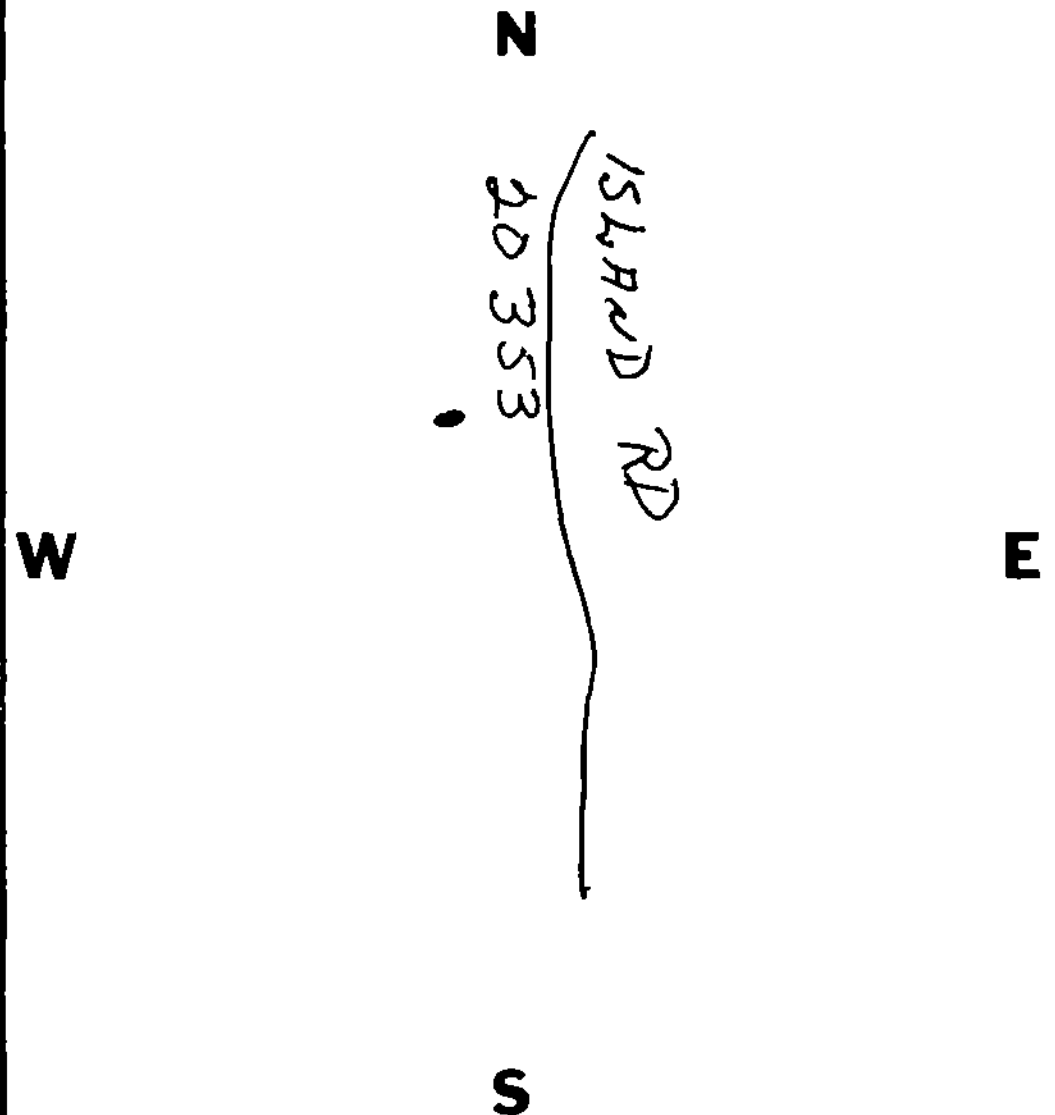

DRILLING FIRM D.L. WHITESED
ADDRESS Box 76 TARTLTON

DATE 12/27/90
SIGNED D.L. Whitesed

*If additional space is needed to complete well log, use next consecutive numbered form.

ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224