WELL LOG AND DRILLING REPORT

661225

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

NO CARBON PAPER NECESSARY- SELF-TRANSCRIBING

Permit Number _____

COUNTY Wood TOWNSHIP G. Rapids SECTION OF TOWNSHIP _____

OWNER DARRELL KNAPP ADDRESS 16537 WAPOKENETA Rd.

LOCATION OF PROPERTY SAME GRAND RAPIDS, O 43522

CONSTRUCTION DETAILS

Casing diameter 5 5/8 I.D. Length of casing 43 ft.

Type of screen _____ Length of screen _____

Type of pump Sub.

Capacity of pump 10 GPM

Depth of pump setting 40 ft.

Date of completion 6-4-87

Rotary ☒ or Cable ☐

BAILING OR PUMPING TEST
(specify one by circling)

Test rate 15 gpm Duration of test 1 hrs

Drawdown 0 ft Date 6-4-87

Static level (depth to water) 24 ft.

Quality (clear, cloudy, taste, odor) CLEAR-SWEET

Pump installed by TIPLADY & MEYER

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
CLAY	0 ft	43 ft
ROCK	43	50 ft.
WATER AT 50 ft.		

SKETCH SHOWING LOCATION

Locate in reference to numbered state highways, street intersections, county roads, etc.

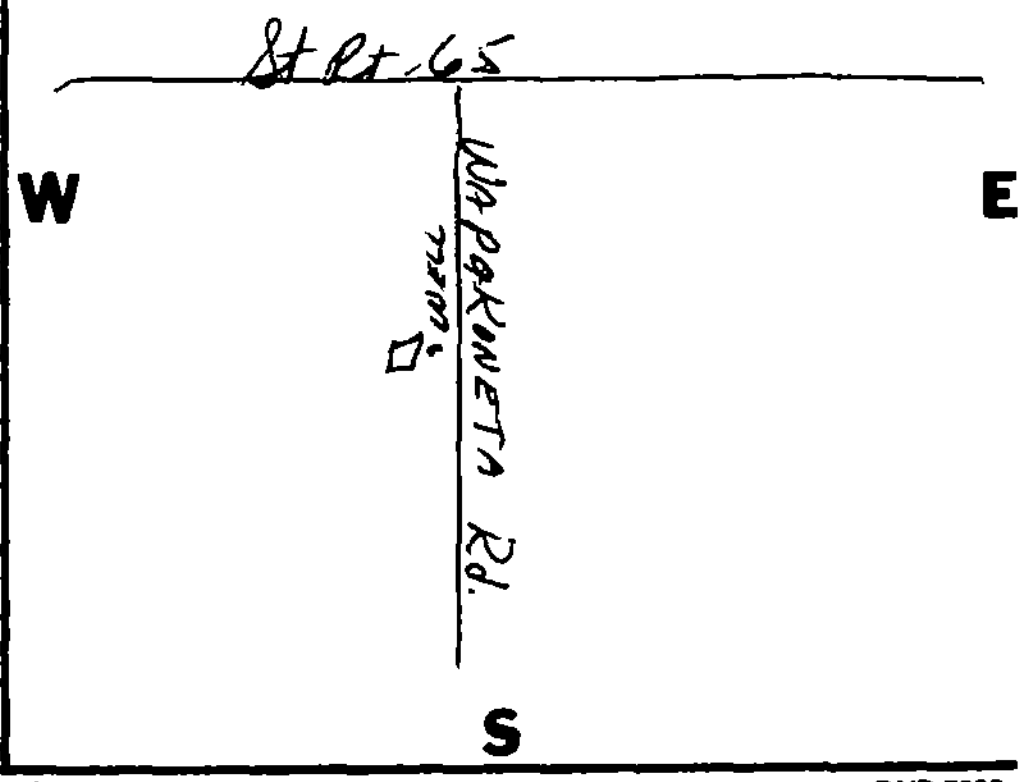

* If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802

DRILLING FIRM TIPLADY & MEYER REGISTRATION NUMBER 61 DATE 6-4-87

ADDRESS 7146 MANORE Rd. WHITEHOUSE SIGNED Norman Tiplady

Completion of this form is required by 1521.05, Ohio Revised Code - file within 30 days after completion.

WHITE ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224 / Blue - Customer's Copy / Pink - Driller's Copy / Green - Local Health Dept Copy