

WELL LOG AND DRILLING REPORT

679821

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

Permit Number 105134

COUNTY Franklin TOWNSHIP Pratt SECTION OF TOWNSHIP _____
OWNER Donald F. Jones ADDRESS 44662
LOCATION OF PROPERTY 6011 Picksville Drive S.W. Navarre Ohio

CONSTRUCTION DETAILS

Casing diameter 6 1/2" - 5" Length of casing 21' - 320'
Type of screen _____ Length of screen _____
Type of pump Submersible
Capacity of pump 750 G.P.M.
Depth of pump setting 315'
Date of completion 9-3-1990
Rotary ☒ or Cable ☐

BAILING OR PUMPING TEST

(specify one by circling)

Test rate 15 gpm Duration of test 2 hrs
Drawdown 30 ft Date 7-30-1990
Static level (depth to water) 240 ft
Quality (clear, cloudy, taste, odor) Good
Pump installed by Stoffel's Well Drilling

WELL LOG*

SKETCH SHOWING LOCATION


Formations: sandstone, shale,
limestone, gravel, clay

From

To

Locate in reference to numbered
state highways, street intersections, county roads, etc.

<u>Brown Sandstone</u>	0 ft	20 ft
<u>Gray Shale</u>	20'	40'
<u>Limestone</u>	40'	42'
<u>Coal</u>	42'	43'
<u>Gray Shale</u>	43'	46'
<u>Gray Sandstone</u>	46'	53'
<u>Gray Sandstone</u>	53'	75'
<u>Gray Sandstone</u>	75'	90'
<u>Gray Sandstone</u>	90'	112'
<u>Limestone</u>	112'	114'
<u>Gray Sandstone</u>	114'	129'
<u>Gray Shale</u>	129'	132'
<u>Limestone</u>	132'	135'
<u>Gray Sandstone</u>	135'	150'
<u>Gray Shale</u>	150'	170'
<u>Coal</u>	170'	172'
<u>Gray Sandstone</u>	172'	176'

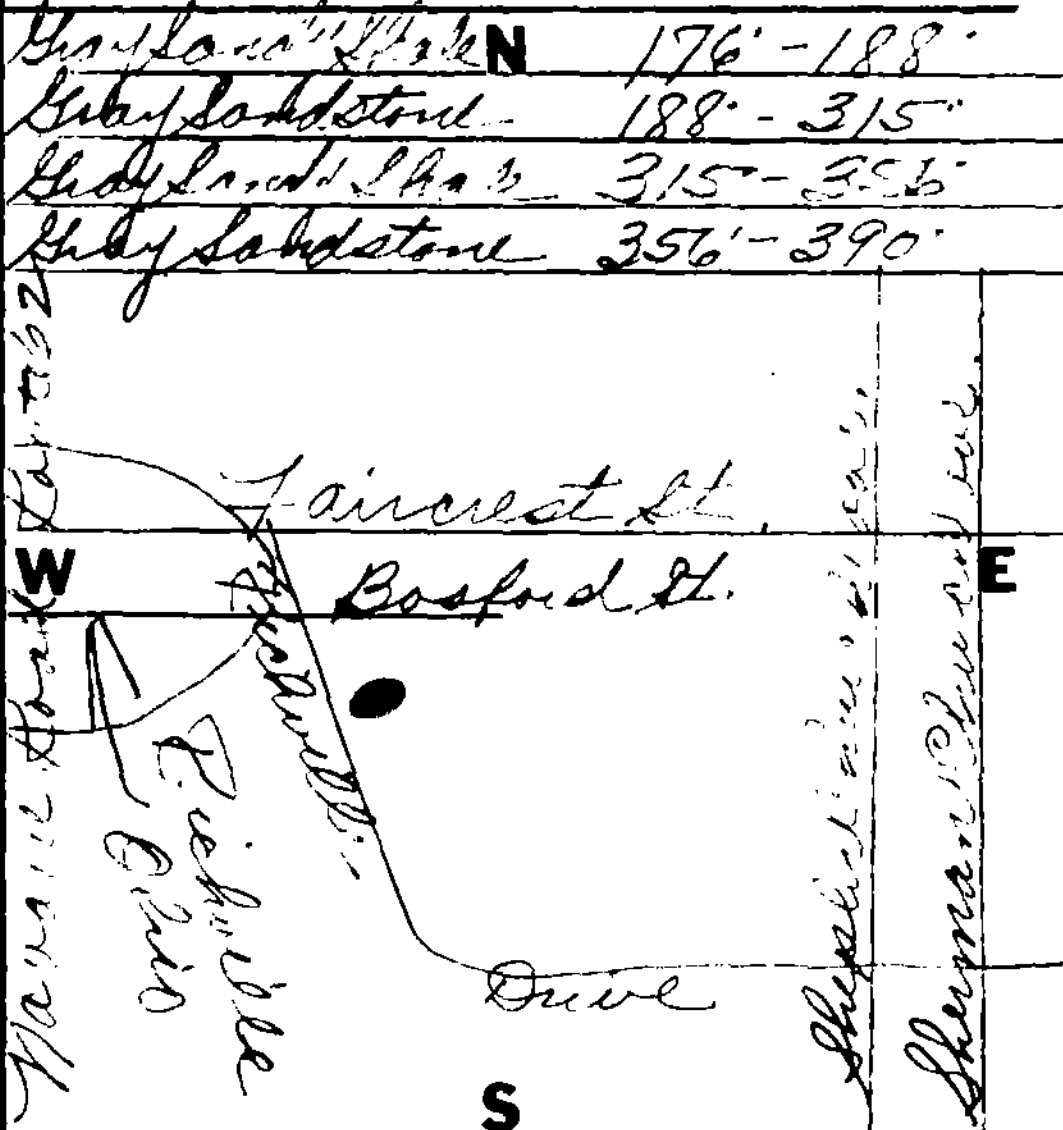

* If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802

DRILLING FIRM STOFFEL'S WELL DRILLING REGISTRATION NUMBER 330 DATE 7-30-1990
ADDRESS 4510 Cleveland Ave., S.E.
Canton, Ohio 44707 SIGNED Stoffel

Completion of this form is required by 1521.05, Ohio Revised Code - file within 30 days after completion.

WHITE ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224 / Blue - Customer's Copy / Pink - Driller's Copy / Green - Local Health Dept. Copy