

WELL LOG AND DRILLING REPORT

680640

NO CARBON PAPER
NECESSARY -
SELF-TRANSCRIBING

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
Fountain Square
Columbus, Ohio 43224

Permit Number 110-89

COUNTY Perry TOWNSHIP # THORN SECTION OF TOWNSHIP _____
OWNER J. D. WINNESTAFFEN ADDRESS 6820 SHAKES DR. REYNOLDSBURG ⁴³⁰⁶⁸
LOCATION OF PROPERTY 11840 TOWNSHIP RD #406

CONSTRUCTION DETAILS

Casing diameter 5" Length of casing 36'
Type of screen 3/8" DRILLED Length of screen 30"
Type of pump SUB
Capacity of pump 10
Depth of pump setting 30'
Date of completion 2-16-90
Rotary ☐ or Cable ☒

BAILING OR PUMPING TEST

(specify one by circling)


Test rate 10+ gpm Duration of test 2 hrs
Drawdown 5' ft Date 2-16-90
Static level (depth to water) 4' ft
Quality (clear, cloudy, taste, odor) CLEAR
Pump installed by Phillips well DRK6

WELL LOG*

Formations: sandstone, shale, limestone, gravel, clay	From	To
<u>TOP SOIL</u>	<u>0 ft</u>	<u>6 ft</u>
<u>CLAY</u>	<u>6</u>	<u>14</u>
<u>SANDY</u>	<u>14</u>	<u>17</u>
<u>CLAY</u>	<u>17</u>	<u>28</u>
<u>SAND-GRAV</u>	<u>28</u>	<u>36</u>

SKETCH SHOWING LOCATION

Locate in reference to numbered
state highways, street intersections, county roads, etc.

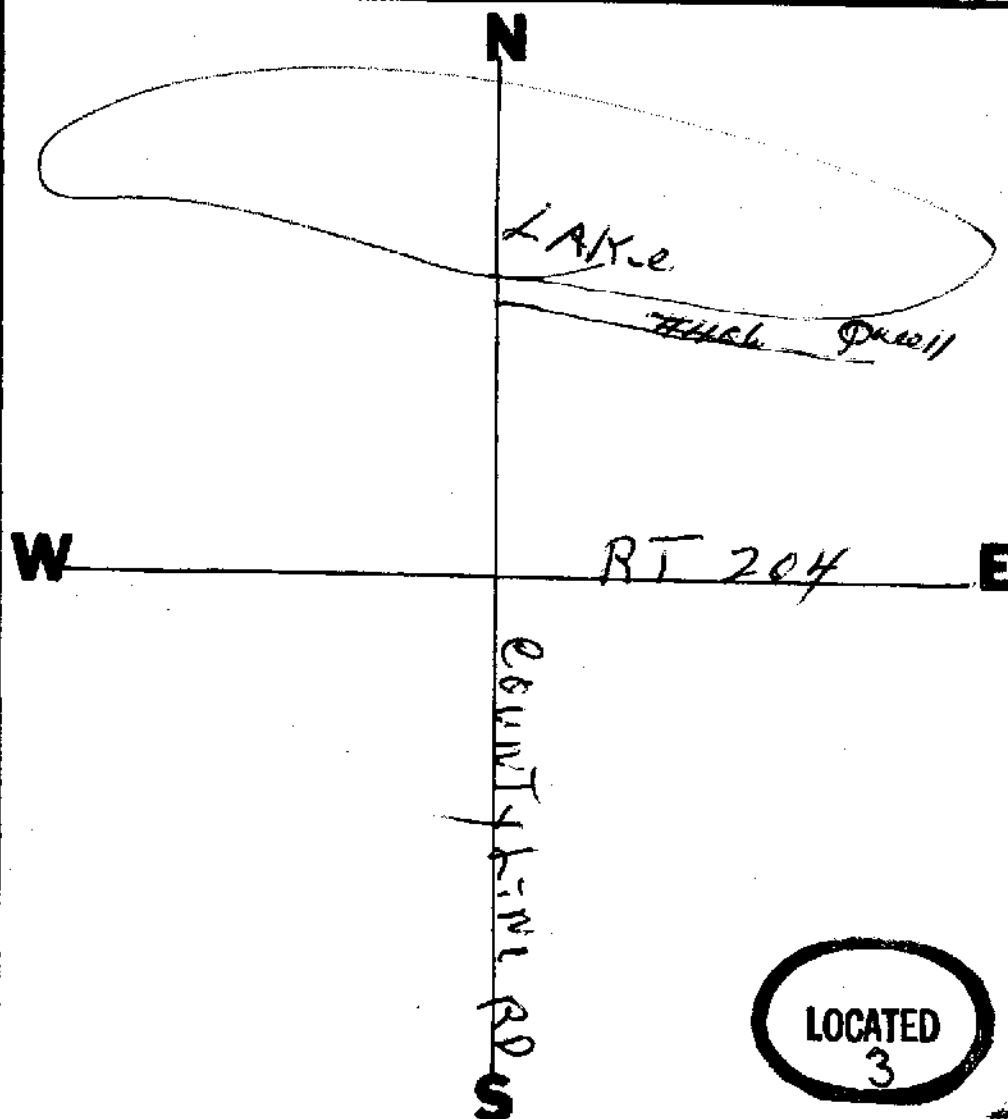

LOCATED
3

* If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802

DRILLING FIRM Phillips well DRK6 REGISTRATION NUMBER 809 DATE 7-20-90
ADDRESS 7162 GRUBB RD - THORNVILLE ⁴³⁰⁷⁶ SIGNED J. D. Winnestaffen

Completion of this form is required by 1521.05, Ohio Revised Code - file within 30 days after completion.

WHITE ORIGINAL COPY - ODNR, DIVISION OF WATER, FOUNTAIN SQ., COLS., OHIO 43224 / Blue - Customer's Copy / Pink - Driller's Copy / Green - Local Health Dept. Copy

5453

9-562