WELL LOG AND DRILLING REPORT

State of Ohio
DEPARTMENT OF NATURAL RESOURCES
Division of Water
1939 Fountain Square Drive
Columbus, Ohio 43224

691895

TYPE OR USE PEN
SELF-TRANSCRIBING
PRESS HARD!

Permit Number _____

COUNTY Montgomery TOWNSHIP Butler SECTION OF TOWNSHIP _____

OWNER Lou Earls (898-7366) PROPERTY ADDRESS 2201 Kershner Rd

LOCATION OF PROPERTY 2201 Kershner Rd, Vadalia

CONSTRUCTION DETAILS

CASING

Casing Diameter 5 5/8 galv in. Length of Casing 47 ft ft.

Type: ☒ Steel ☐ Galv. ☐ PVC ☐ Other _____

Joints: ☐ Threaded ☒ Welded ☐ Solvent ☐ Other _____

SCREEN

Type (wire wrapped, louvered, etc.) _____ Material _____

Length _____ ft. Diameter _____ in.

Set between _____ ft. and _____ ft. Slot _____

GROUT

Material _____ Volume used _____

Method of installation _____

Depth: placed from _____ ft. to _____ ft.

☐ Rotary ☐ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____

BAILING OR PUMPING TEST
(specify one by circling)

WELL TEST

Test rate 28 gpm Duration of test 1 hr hrs.

Drawdown (water level during pumping) to 35 ft ft.

Measured from: ☐ top of casing ☐ ground level ☐ Other _____

Static Level (depth to water) 20 ft ft. Date: 10-27-90

Quality (clear, cloudy, taste, odor) clearing

PUMP

Type of pump _____ Capacity _____ gpm

Pump set at _____ ft.

Pump installed by _____

Pitless Device ☐ Adapter ☐ Preassembled unit

Use of Well _____

WELL LOG*

Show color, texture, hardness, and formation: sandstone, shale, limestone, gravel, clay, sand	From	To
dirt and yellow hardpan	0 ft.	28 ft.
grey hardpan	28	46
Med blue shale	45	60
hard blue shale	60	62

SKETCH SHOWING LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

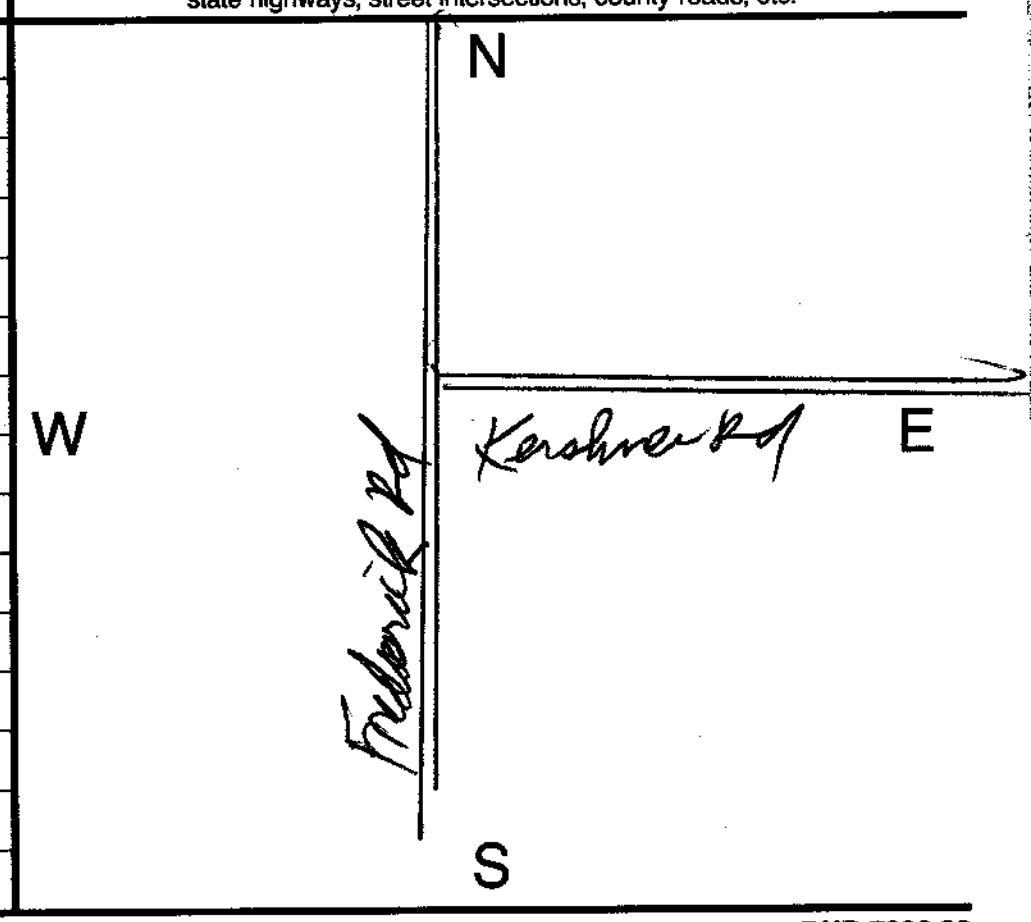

* If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802.88

DRILLING FIRM LORIN C. SNELL

ADDRESS 9313 WEST MARKLEY ROAD

CITY, STATE, ZIP LAURA, OHIO 45337 698-4222

SIGNED [signature]

DATE _____

ODH REGISTRATION NUMBER 0319

Completion of this form is required by 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.

ORIGINAL COPY - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's Copy Pink - Driller's Copy Green - Local Health Dept. Copy