

706128

Permit Number _____

COUNTY Warren TOWNSHIP Turtlecreek SECTION/LOT NO. _____
(CIRCLE ONE)
OWNER/BUILDER Judy Holley PROPERTY ADDRESS 1731 Oregonia Rd.
(CIRCLE ONE OR BOTH) (ADDRESS OF WELL LOCATION A)
LOCATION OF PROPERTY 2 mi east of S.R. 48

CASING Diameter <u>5 5/8</u> in. Length <u>26</u> ft. Wall Thickness <u>1/4</u> in. Type: ☐ Steel ☒ Galv. ☐ PVC ☐ Other _____ Joints: ☐ Threaded ☒ Welded ☐ Solvent ☐ Other _____ SCREEN Type (wire wrapped, louvered, etc.) _____ Material _____ Length _____ ft. Diameter _____ in. Set between _____ ft. and _____ ft. Slot _____ ☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____ Date of completion _____	GROUT Material <u>Benseal</u> Volume used <u>40#</u> Method of installation <u>Dry pack</u> Depth: placed from _____ ft. to <u>26</u> ft. GRAVEL PACK Material _____ Volume used _____ Method of installation _____ Depth: placed from _____ ft. to _____ ft. Pitless Device ☒ Adapter ☐ Preassembled unit Use of Well <u>Household</u>
---	--

WELL TEST

Type of pump submersible Capacity ~~10~~ 5 gpm
Pump set at 22 ft.
Pump installed by Toto Well Drilling

Bailing ☒ or Pumping ☐
Test rate 5 gpm Duration of test 3 hrs.
Drawdown 12' ft.

WELL LOG*


INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.
Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

Measured from: ☒ top of casing ☐ ground level ☐ Other _____
 Static Level (depth to water) 4 ft. Date: _____
 Quality (clear, cloudy, taste, odor) _____
 (Attach a copy of the pumping test record, per 1521.05, ORC)

[illegible]

SKETCH SHOWING LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

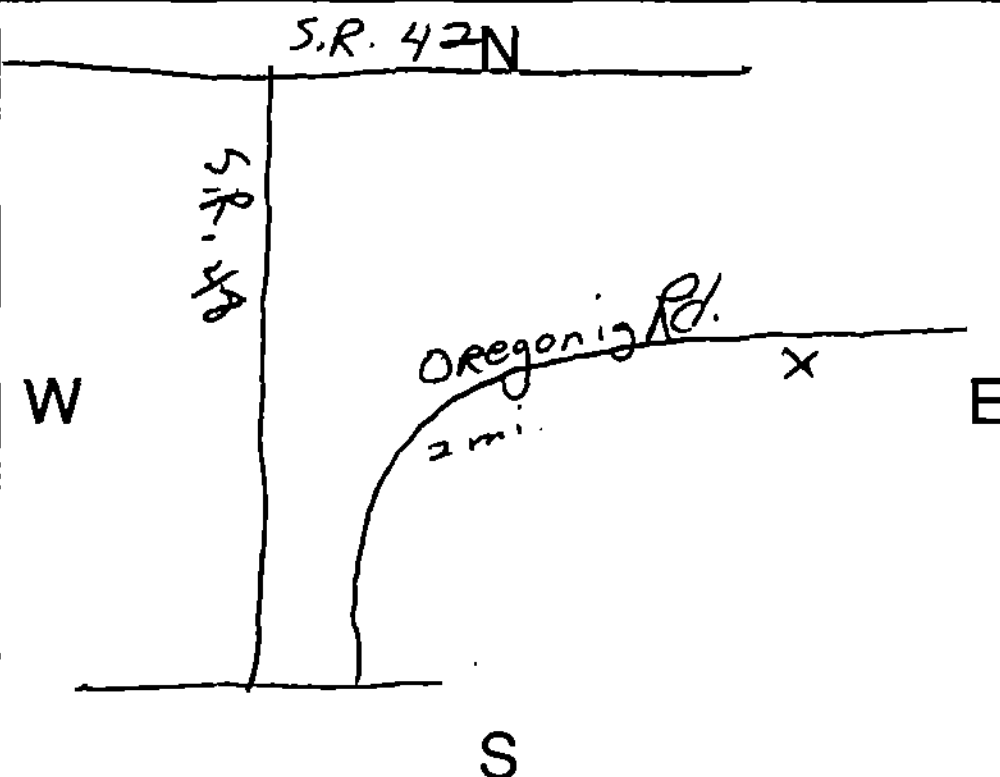

* If additional space is needed to complete well log, use next consecutively numbered form

DRILLING FIRM Lowell Well Drilling
ADDRESS 2845 Blackhawk Rd.
CITY, STATE, ZIP Lettinga Oh. 45420

SIGNED Erman K. Solto
DATE _____
ODH REGISTRATION NUMBER 749

Completion of this form is required by 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.

ORIGINAL COPY - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's Copy Pink - Driller's Copy Green - Local Health Dept. Copy