

WELL LOG AND DRILLING REPORT

TYPE OR USE PEN
SELF TRANSCRIBING
PRESS HARD

Ohio Department of Natural Resources, Division of Water
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739

747283
92-98
Permit Number

COUNTY Fulton TOWNSHIP Gorham SECTION/LOT No. 27
(CIRCLE ONE)
OWNER/BUILDER William J. Mapes PROPERTY ADDRESS 13034 Ct Rd 22
(CIRCLE ONE OR BOTH) (ADDRESS OF WELL LOCATION A)
LOCATION OF PROPERTY 13034 Ct Rd 22 Fayette Ohio

CONSTRUCTION DETAILS

CASING Borehole Diameter 6 in.
① Diameter 6 in. Length 126 ft. Wall Thickness .250 in. Material Bentontite Volume used 100 #
② Diameter _____ in. Length _____ ft. Wall Thickness _____ in. Method of installation Placed around casing
Type: ① Steel ② Galv. ③ PVC ④ _____
Joints: ① Threaded ② Welded ③ Solvent ④ _____
Liner: Length _____ Type _____ Wall Thickness _____ in. Depth: placed from _____ ft. to _____ ft.
SCREEN Type wire wrapped (rouvered, etc.) Material SS
Length 5 ft. Diameter 5 in. ☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____
Set between 126 ft. and 131 ft. Slot 6 Date of Completion 7-22-92

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

	From	To
<u>Topsoil Yellow Sand</u>	<u>0</u>	<u>1.5</u>
<u>Yellow Soft Clay</u>	<u>2</u>	<u>12</u>
<u>Blue Clay Soft</u>	<u>13</u>	<u>46</u>
<u>Blue Gray Hard Pan</u>	<u>47</u>	<u>57</u>
<u>Fine Gray Sand & Water</u>	<u>58</u>	<u>61</u>
<u>Hard Pan Gravel</u>	<u>61</u>	<u>67</u>
<u>Blue Clay Soft</u>	<u>68</u>	<u>110</u>
<u>Very Loose Gray Sand</u>	<u>111</u>	<u>125</u>
<u>Sand & Gravel Water</u>	<u>126</u>	<u>131</u>

Water From 58 61

Water From 126 131

WELL TEST

☒ Bailing ☐ Pumping* ☐ Other _____
Test rate 24 gpm Duration of test 1 hrs.
Drawdown 5 ft.
Measured from: ☐ top of casing ☒ ground level ☐ Other _____
Static Level (depth to water) 2 ft. Date: 7-22-92
Quality Clear (cloudy, taste, odor) _____


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Sub Capacity 12 gpm
Pump set at 46 ft.
Pump installed by Larry Rupp

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways,
street intersections, county roads, etc.

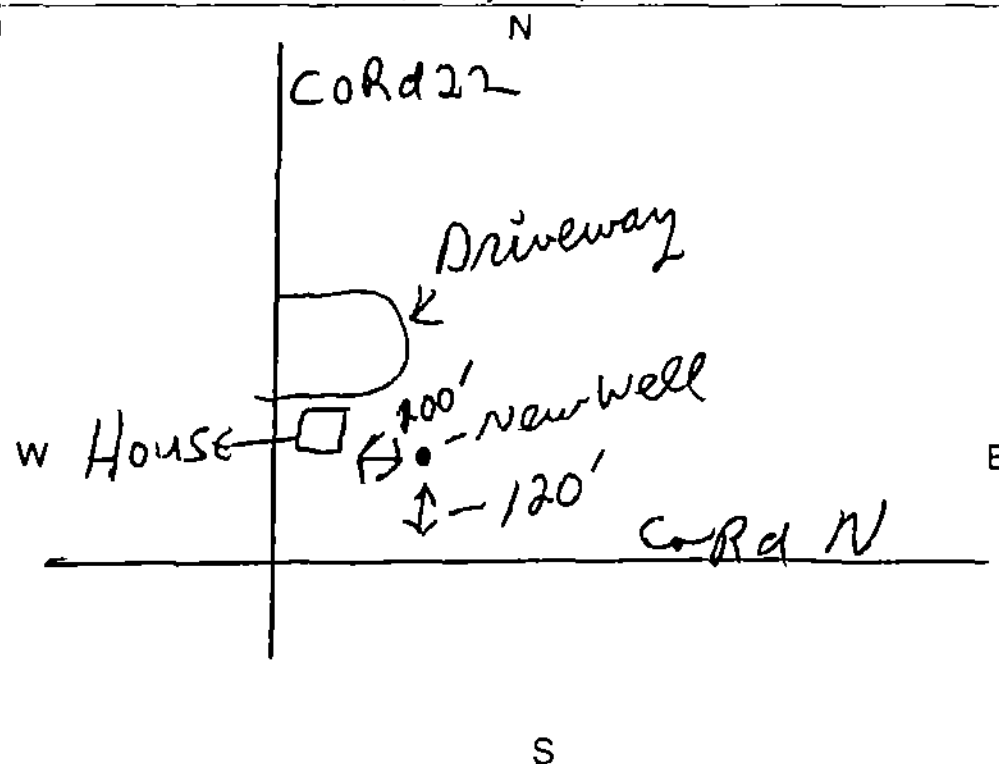

*If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802.90

Drilling Firm Larry Rupp & Stanley Frey
Address P.O. Box 98
City, State, Zip Stuyvesant Ohio 43557

Signed Larry Rupp
Date 7-22-92
ODH Registration Number 1019

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.
ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy