

WELL LOG AND DRILLING REPORT

747299

TYPE OR USE PEN
SELF TRANSCRIBING
PRESS HARD

Ohio Department of Natural Resources, Division of Water
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739

Permit Number

COUNTY Fulton

TOWNSHIP German

SECTION/LOT No.
(CIRCLE ONE)

OWNER/BUILDER Paul & Martha Campbell
(CIRCLE ONE OR BOTH)

PROPERTY ADDRESS 7453 CR 19

(ADDRESS OF WELL LOCATION A)

LOCATION OF PROPERTY

Wauson, Ohio 43567

CONSTRUCTION DETAILS

CASING Borehole Diameter 5 in.
 ① Diameter 5 in. Length 150 ft. Wall Thickness .258 in. Material Bentonite Volume used 50#
 ② Diameter _____ in. Length _____ ft. Wall Thickness _____ in. Method of installation Placed around casing
 Type: ① Steel ② Galv. ③ PVC ④ Other _____
 Joints: ① Threaded ② Welded ③ Solvent ④ Other _____
 Liner: Length _____ Type _____ Wall Thickness _____ in. Depth: placed from _____ ft. to _____ ft.
SCREEN Type (wire wrapped, louvered, etc.) _____ Material SS
 Length 4 ft. Diameter 4 in. ☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____
 Set between 150 ft. and 153 ft. Slot 10

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

	From	To
<u>Topsoil</u>	<u>0</u>	<u>1</u>
<u>Soft Yellow Clay</u>	<u>2</u>	<u>13</u>
<u>Soft Gray Clay</u>	<u>13</u>	<u>137</u>
<u>Gravel & Hard Pan</u>	<u>137</u>	<u>146</u>
<u>Gravelly Sand & Water</u>	<u>147</u>	<u>153</u>
<u>Water</u>	<u>147</u>	<u>153</u>

WELL TEST

☒ Bailing ☐ Pumping* ☐ Other _____
 Test rate 12 gpm Duration of test 2 hrs.
 Drawdown 17 ft.
 Measured from: ☐ top of casing ☒ ground level ☐ Other _____
 Static Level (depth to water) 25 ft. Date: 7-10-93
 Quality (clear) cloudy, taste, odor


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Sub Capacity 9 gpm
 Pump set at 67 ft.
 Pump installed by Larry Rupp

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways,
street intersections, county roads, etc.

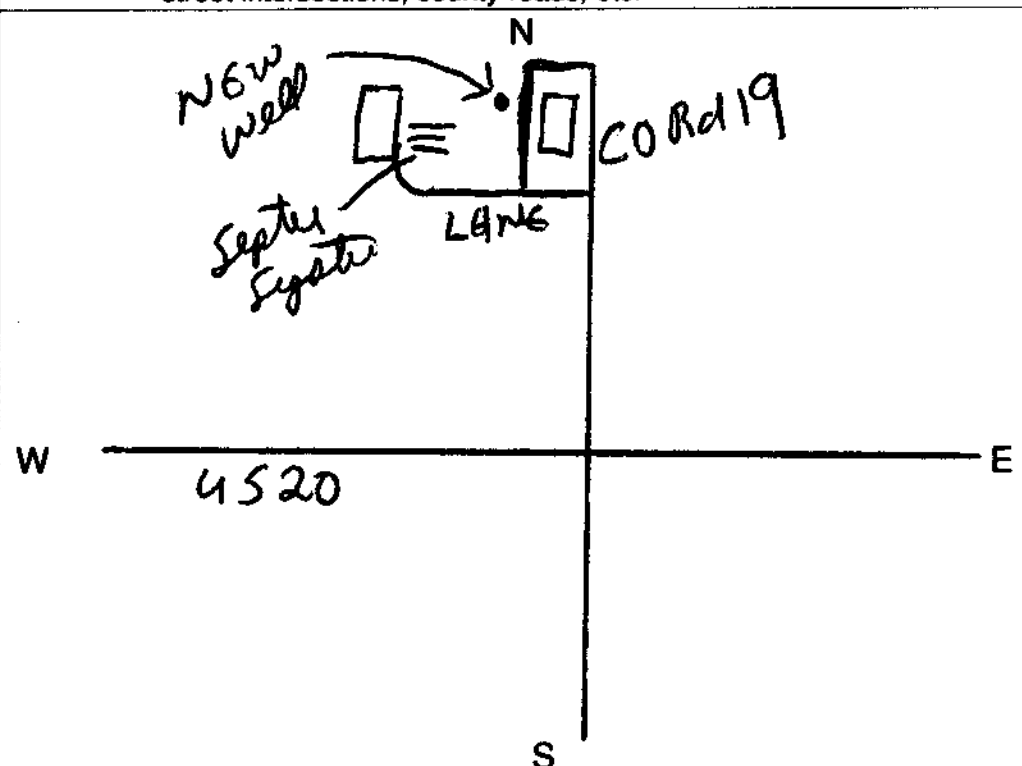

*If additional space is needed to complete well log, use next consecutively numbered form.

DNR 7802.90

Drilling Firm Larry Rupp & Family Dry Well Drilling Signed Larry Rupp
 Address R 1 Box 98 Date 7-10-93
 City, State, Zip Stuyvesant Ohio 43557 ODH Registration Number 1019

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.

ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy

5215