

# WELL LOG AND DRILLING REPORT

TYPE OR USE PEN  
SELF TRANSCRIBING  
PRESS HARD

Ohio Department of Natural Resources, Division of Water  
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739

748261

Permit Number 791

COUNTY Stark

TOWNSHIP Sugar Creek

SECTION/LOT No. 23

OWNER/BUILDER  
(CIRCLE ONE OR BOTH)

Ronal Lee Metz

PROPERTY ADDRESS

9387 Justus Ave Beach City, O

LOCATION OF PROPERTY 1/4 mile North of Crestline St.

## CONSTRUCTION DETAILS

**CASING** Borehole Diameter 5 in.

① Diameter 5 1/2 in. Length 182 ft. Wall Thickness 2 1/4 in. Material 20 MESH FIRECLAY Volume used 400 LBS.

② Diameter \_\_\_\_\_ in. Length \_\_\_\_\_ ft. Wall Thickness \_\_\_\_\_ in. Method of installation DIPY GROUT

Type: ☒ Steel ☐ Galv. ☐ PVC ☐ Other \_\_\_\_\_

Joints: ☒ Threaded ☐ Welded ☐ Solvent ☐ Other \_\_\_\_\_

Liner: Length \_\_\_\_\_ Type \_\_\_\_\_ Wall Thickness \_\_\_\_\_ in. Depth: placed from \_\_\_\_\_ ft. to \_\_\_\_\_ ft.

**SCREEN**

Type (wire wrapped, louvered, etc.) \_\_\_\_\_ Material \_\_\_\_\_

Length \_\_\_\_\_ ft. Diameter \_\_\_\_\_ in.

Set between \_\_\_\_\_ ft. and \_\_\_\_\_ ft. Slot \_\_\_\_\_

**GROUT**

Pitless Device ☐ Adapter ☐ Preassembled unit

Use of Well DOMESTIC

☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other \_\_\_\_\_

Date of Completion \_\_\_\_\_

## WELL LOG\*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:  
sandstone, shale, limestone, gravel, clay, sand, etc.

|                       | From | To  |
|-----------------------|------|-----|
| SAND & GRAVEL         | 0    | 20  |
| GRAVEL & CLAY         | 20   | 40  |
| SAND GRAVEL           | 40   | 64  |
| FINE SAND BROKEN COAL | 64   | 150 |
| FINE SAND             | 150  | 178 |
| SAND & GRAVEL         | 178  | 182 |

WATER ENCOUNTERED  
64 To 182

## WELL TEST

☒ Bailing ☐ Pumping ☐ Other \_\_\_\_\_

Test rate 5 gpm Duration of test 90 MIN hrs.

Drawdown 8 ft.

Measured from: ☒ top of casing ☐ ground level ☐ Other \_\_\_\_\_

Static Level (depth to water) 5.3 ft. Date: 1-8-94

Quality (clear, cloudy, taste, odor) CLOUDY

\*(Attach a copy of the pumping test record, per section 1521.05, ORC)

## PUMP


Type of pump \_\_\_\_\_ Capacity \_\_\_\_\_ gpm

Pump set at \_\_\_\_\_ ft.

Pump installed by \_\_\_\_\_

## SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways,  
street intersections, county roads, etc.

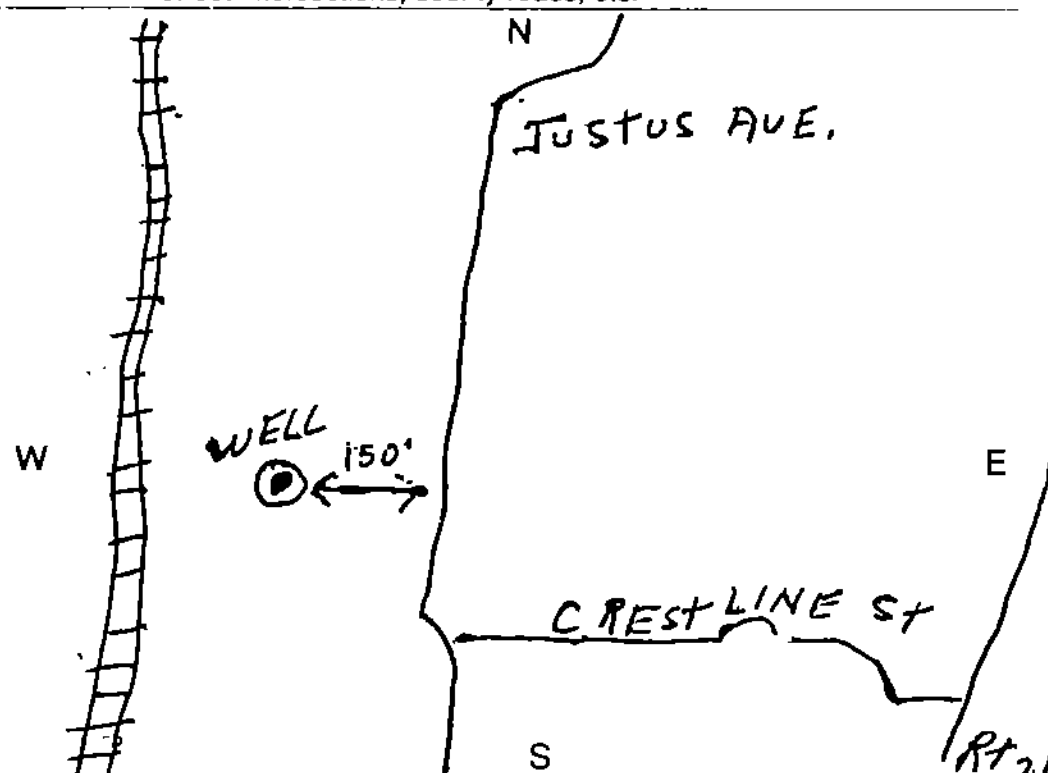

\*If additional space is needed to complete well log, use next consecutively numbered form.

Drilling Firm Don Shetler Water Well Drilling

Address 8044 Fohl St. S.W.

City, State, Zip Marietta, O 44662

Signed Don Shetler

Date 1-18-94

ODH Registration Number 584

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.

ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy

DNR 7802.90