

DNR 7802.93
TYPE OR USE PEN
SELF TRANSCRIBING
PRESS HARD

WELL LOG AND DRILLING REPORT

Ohio Department of Natural Resources, Division of Water
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739
Permit Number 93-111

COUNTY Fulton TOWNSHIP German SECTION/LOT No. _____
(CIRCLE ONE)
OWNER/BUILDER Randal Schumaker PROPERTY ADDRESS 20623 95 20A
(CIRCLE ONE OR BOTH) (ADDRESS OF WELL LOCATION A)
LOCATION OF PROPERTY Archbold, Ohio 43502

CONSTRUCTION DETAILS

CASING Borehole Diameter 6 in. **GROUT** Material Bentonite Volume used 50#
① Diameter 6 in. Length 148 ft. Wall Thickness .250 in. Method of installation around casing
② Diameter _____ in. Length _____ ft. Wall Thickness _____ in. Depth: placed from 0 ft. to 84 ft.
Type: ① Steel ① Galv. ② PVC ② Other _____
Joints: ① Threaded ① Welded ② Solvent ② Other _____
Liner: Length _____ Type _____ Wall Thickness _____ in. Depth: placed from _____ ft. to _____ ft.
SCREEN Pitless Device _____ Adapter _____ Preassembled unit _____
Type wire wrapped (louvered, etc.) Material Stainless Steel Use of Well Home
Length 3 ft. Diameter 5 in. ① Rotary X Cable ① Augered ① Driven ① Dug ① Other _____
Set between 148 ft. and 150 ft. Slot 10 Date of Completion 12-28-93

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

	From	To
<u>Topsoil</u>	<u>0</u>	<u>1 1/2</u>
<u>Yellow Clay</u>	<u>1 1/2</u>	<u>12</u>
<u>Very Soft Gray Clay & Fine Sand</u>	<u>12</u>	<u>47</u>
<u>Gray Clay</u>	<u>47</u>	<u>138</u>
<u>Gray Clay & Hard Pan</u>	<u>138</u>	<u>148</u>
<u>Gravel & Fine Sand & Water</u>	<u>148</u>	<u>150</u>

WELL TEST

① Bailing _____ ① Pumping* _____ ① Other _____
Test rate 5 gpm Duration of test 4 hrs.
Drawdown 25 ft.
Measured from: ① top of casing ① ground level ① Other _____
Static Level (depth to water) 51 ft. Date: 12-28-93
Quality clear (cloudy, taste, odor) _____


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump sub Capacity 3 1/2 gpm
Pump set at 92 ft.
Pump installed by Larry Rupp

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways,
street intersections, county roads, etc.

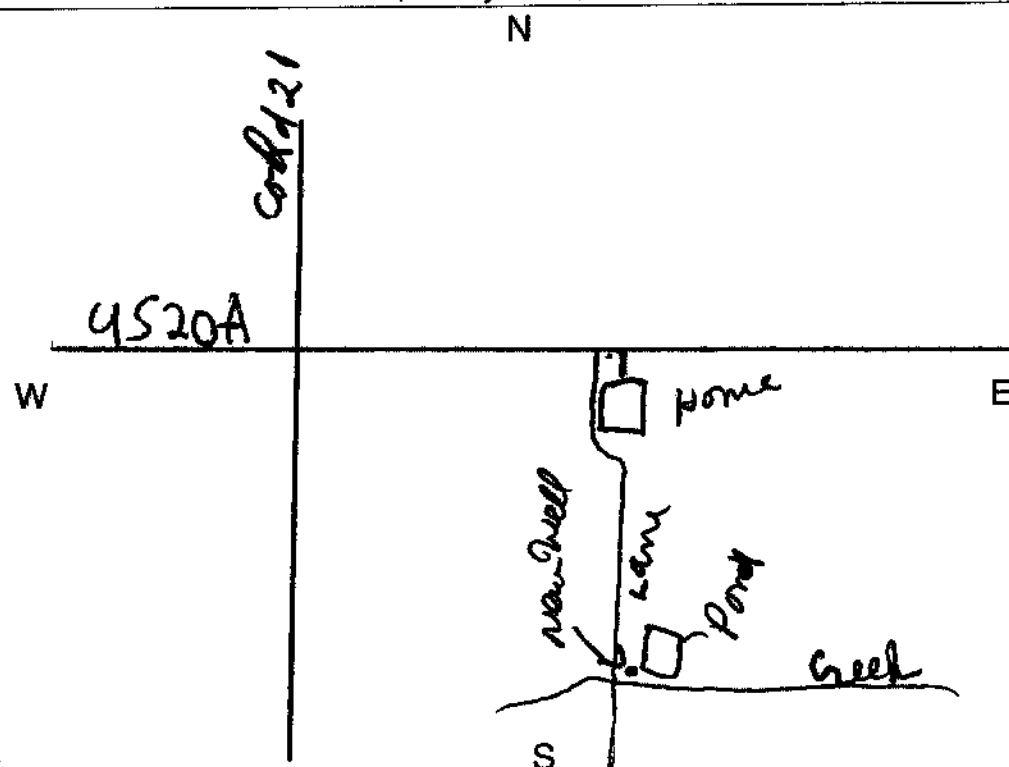

*If additional space is needed to complete well log, use next consecutively numbered form.

I hereby certify the information given is accurate and correct to the best of my knowledge.

Drilling Firm Larry Rupp & Son, Inc.
Address 24-455 - Rd U
City, State, Zip Stryker Ohio 43557

Signed Larry Rupp
Date 12-28-93
ODH Registration Number 1019

5215

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.
ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy