

COUNTY Cuyahoga TOWNSHIP Dover SECTION/LOT No. _____
(CIRCLE ONE)
OWNER/BUILDER Douglas K. Nelson PROPERTY ADDRESS 28866 Hilliard Blvd.
(CIRCLE ONE OR BOTH) (ADDRESS OF WELL LOCATION A)
LOCATION OF PROPERTY Rt 2 / S. on Crocker Bossett to Hilliard East 1/4 mi. West Lake, Oh. 44145

CONSTRUCTION DETAILS

CASING				Borehole Diameter		GROUT	
[1] Diameter	6	in.	Length	25	ft.	Wall Thickness	.156 in.
[2] Diameter		in.	Length		ft.	Wall Thickness	
Type:	[1] Steel	☒ Galv.	[1] PVC	[1]		Depth: placed from	0
	[2]		[2]			ft. to	25
			[2] Other	6" Drive Shoe			
Joints:	☒ Threaded	[1] Welded	[1] Solvent	[1]		GRAVEL PACK (Filter Pack)	
	[2]	[2]	[2] Other			Material	
						Volume used	
Liner:	Length	Type	Wall Thickness			Method of installation	
						Depth: placed from	
						ft. to	
SCREEN				Pitless Device			
Type (wire wrapped, louvered, etc.)			Material			☒ Adapter	☐ Preassembled unit
Length		ft.	Diameter			Use of Well	Domestic
Set between		ft. and				☐ Rotary	☒ Cable
						☐ Augered	☐ Driven
			Slot			☐ Dug	☐ Other
						Date of Completion	10/7/97

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

sandstone, shale, limestone, gravel, clay, sand, etc.	From	To
Brown Top Soil	0	12
Black shale	12	87

Water at 45 ft
Water at 82 ft

WELL TEST

☒ Bailing ☐ Pumping* ☐ Other _____

Test rate 12 gpm Duration of test 2 hrs.

Drawdown 35 ft.

Measured from: ☒ top of casing ☐ ground level ☐ Other _____

Static Level (depth to water) 10 ft. Date: 10/7/97

Quality (clear, cloudy, taste, odor) clear - sulphur odor


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Submersible Capacity 10 gpm
Pump set at 84 ft.
Pump installed by J. Massey - Massey Drilling & Const. Co.

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

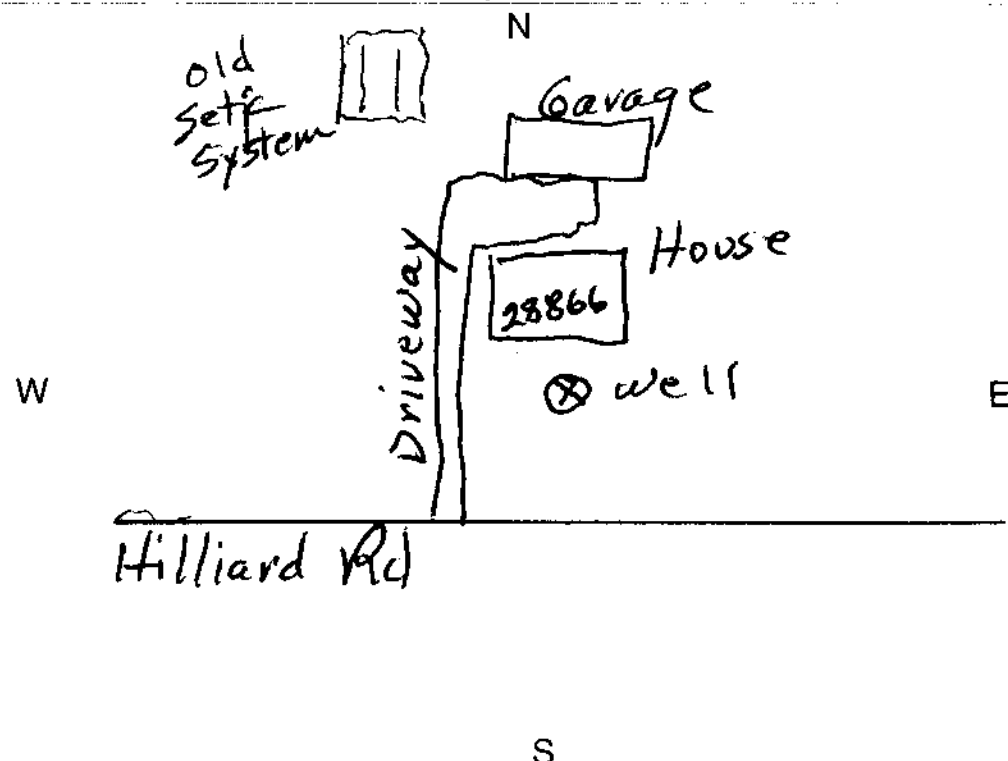

*If additional space is needed to complete well log, use next consecutively numbered form.

I hereby certify the information given is accurate and correct to the best of my knowledge.

Drilling Firm Massey Drilling & Const. Inc. Signed Laurence L. Marney
Address 291 N Abbe Rd Date 10/17/97

City, State, Zip Elyria, Oh. 44035 ODH Registration Number 1628

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.
ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224
 Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy