DNR 7802.93
TYPE OR USE PEN
SELF TRANSCRIBING
PRESS HARD

WELL LOG AND DRILLING REPORT

786852

Ohio Department of Natural Resources, Divison of Water
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739

Permit Number _____

COUNTY Lucas TOWNSHIP Providence SECTION/LOT No. _____ (CIRCLE ONE)

OWNER/BUILDER (CIRCLE ONE OR BOTH) Robert Butterfield PROPERTY ADDRESS 7810 Pro. Hwy. Swanton (ADDRESS OF WELL LOCATION A)

LOCATION OF PROPERTY Same Swanton Ohio - 43558

CONSTRUCTION DETAILS

CASING Borehole Diameter 8 3/4 in.

[1] Diameter 6 in. Length 65 ft. Wall Thickness S-40 in.

[2] Diameter _____ in. Length _____ ft. Wall Thickness _____ in.

Type: [1] Steel [1] Galv. [1] [2] PVC [1] [2] Other _____

Joints: [1] [2] Threaded [1] [2] Welded [1] [2] Solvent [1] [2] Other _____

Liner: Length _____ Type _____ Wall Thickness _____ in.

SCREEN

Type (wire wrapped, louvered, etc.) _____ Material _____

Length _____ ft. Diameter _____ in. Set between _____ ft. and _____ ft. Slot _____

GROUT

Material Bentonite Volume used 100 lb

Method of installation poured

Depth: placed from _____ ft. to _____ ft.

GRAVEL PACK (Filter Pack)

Material _____ Volume used _____

Method of installation _____

Depth: placed from _____ ft. to _____ ft.

Pitless Device [1] Adapter [2] Preassembled unit

Use of Well Domestic

[1] Rotary [2] Cable [2] Augered [2] Driven [2] Dug [2] Other _____

Date of Completion 4-18-94

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation: sandstone, shale, limestone, gravel, clay, sand, etc.	From	To
Sand	0	10
clay & gravel	10	65
Shale	65	68
limestone	68	91'6"

WELL TEST

[2] Bailing [1] Pumping* [2] Other _____

Test rate 7 1/2 gpm Duration of test _____ hrs.

Drawdown _____ ft.

Measured from: [2] top of casing [2] ground level [2] Other _____

Static Level (depth to water) _____ ft. Date: _____

Quality (clear, cloudy, taste, odor) Sulfur

*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Submersible Capacity 7 gpm

Pump set at 92 ft.

Pump installed by Mocks Drilling

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

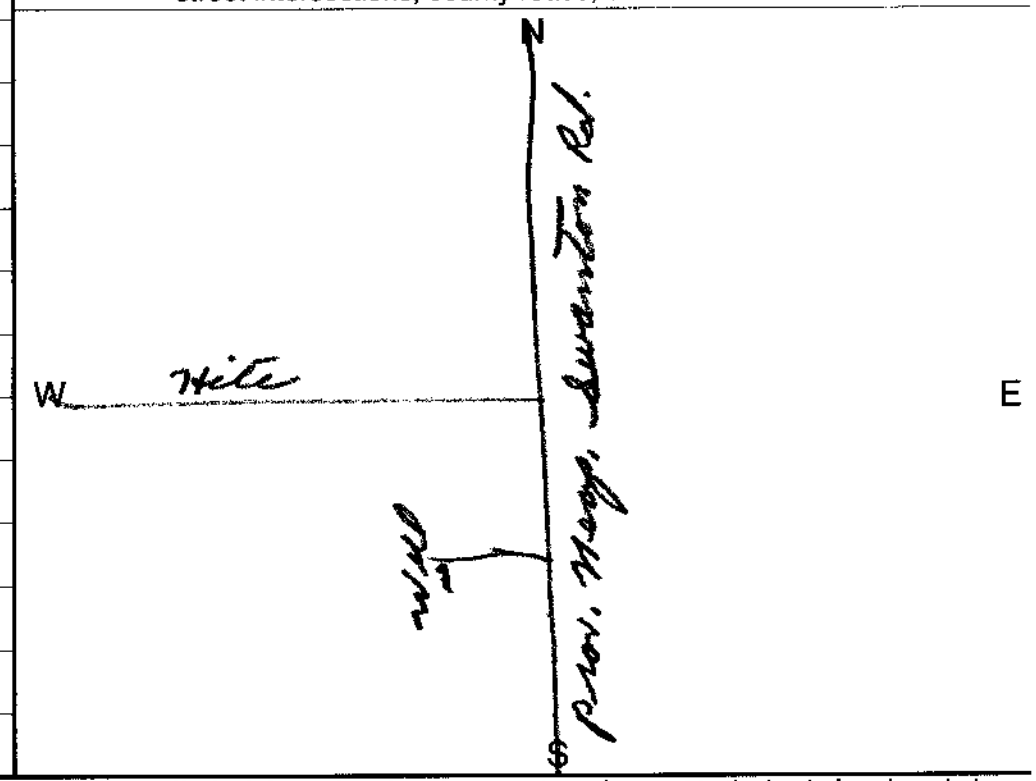

*If additional space is needed to complete well log, use next consecutively numbered form.

I hereby certify the information given is accurate and correct to the best of my knowledge.

Drilling Firm Mocks Drilling

Address 3859-C 5407

City, State, Zip Swanton, Ohio - 43558

Signed _____

Date 7-16-94

ODH Registration Number 304

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.

ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy