

COUNTY CLARK TOWNSHIP PIKE SECTION/LOT No. _____
(CIRCLE ONE)
OWNER/BUILDER Sandy ANDERBORG PROPERTY ADDRESS 2200 Hampton RD
(CIRCLE ONE OR BOTH) ~~(ADDRESS OF WELL LOCATION)~~
LOCATION OF PROPERTY NEW Carlisle OH

CONSTRUCTION DETAILS

CASING		Borehole Diameter <u>5 3/8</u> in.		GROUT	
① Diameter <u>6</u> in.	Length <u>90</u> ft.	Wall Thickness <u>STD</u> in.	Material _____	Volume used _____	
② Diameter _____ in.	Length _____ ft.	Wall Thickness _____ in.	Method of installation _____		
Type: ☒ Steel	☒ Galv.	☐ PVC	① _____	Depth: placed from _____ ft. to _____ ft.	
☐ Threaded	☒ Welded	☐ Solvent	② Other _____	GRAVEL PACK (Filter Pack)	
② _____	② _____	② _____	① _____	Material _____	Volume used _____
② _____	② _____	② _____	② Other _____	Method of installation _____	
Liner: _____	Length _____	Type _____	Wall Thickness _____ in.	Depth: placed from _____ ft. to _____ ft.	
SCREEN			Pitless Device	☐ Adapter	☒ Preassembled unit
Type (wire wrapped, louvered, etc.) _____			Use of Well _____		
Length _____ ft.			☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____		
Set between _____ ft. and _____ ft.			Date of Completion <u>Nov 6</u>		
Slot _____					

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

[illegible]

WELL TEST

☒ Bailing ☐ Pumping* ☐ Other _____
 Test rate 10 gpm Duration of test 8 hrs.
 Drawdown _____ ft.
 Measured from: ☒ top of casing ☐ ground level ☐ Other _____
 Static Level (depth to water) 43 ft. Date: Nov 6
 Quality (clean, cloudy, taste, odor) _____


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump SUBMERSIBLE Capacity 10 gpm
Pump set at 85 ft.
Pump installed by A-1 WELL DRILLING

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

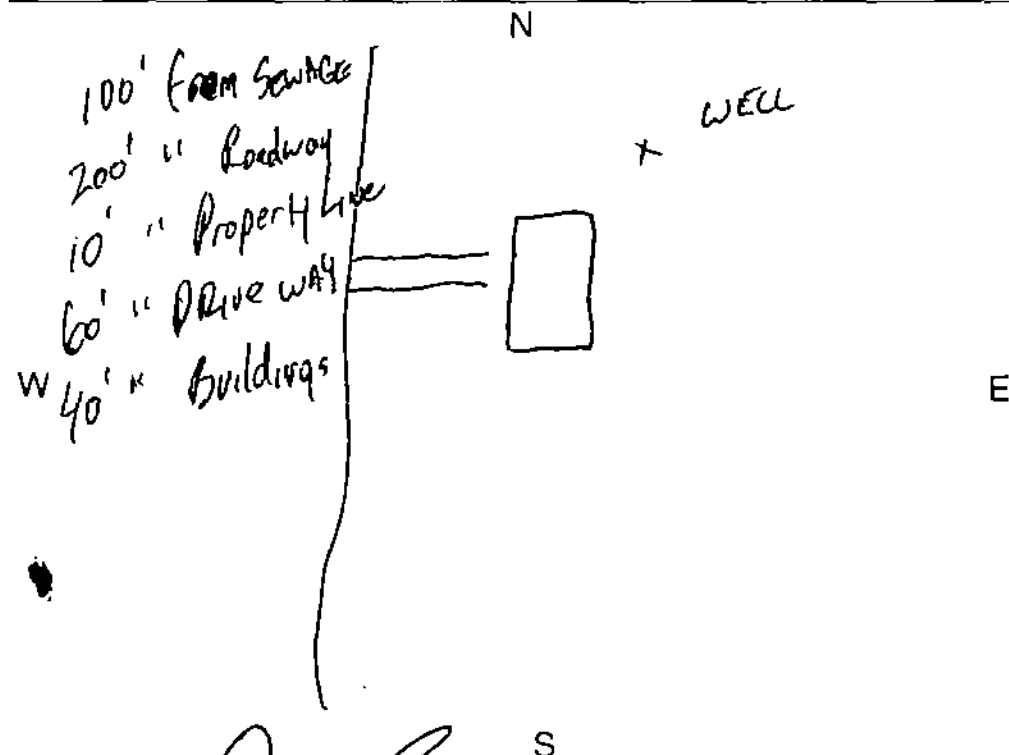

*If additional space is needed to complete well log, use next consecutively numbered form.

I hereby certify the information given is accurate and correct to the best of my knowledge.

Drilling Firm 7-11 WELL DRILLING

Signed

Address 1700 N. 15th St. Apt. 111

Date _____

NEW: Particle

190