

COUNTY Stark TOWNSHIP Perry SECTION/LOT No. _____
(CIRCLE ONE)
OWNER/BUILDER Joan Hall PROPERTY ADDRESS 2317 Leo Ave S.W.
(CIRCLE ONE OR BOTH) (ADDRESS OF WELL LOCATION A)
LOCATION OF PROPERTY South 500' Navarre Rd

CONSTRUCTION DETAILS

CASING Borehole Diameter 8 3/4 in.
① Diameter 5 in. Length 138 ft. Wall Thickness SDR-21 in. Material Bentonite/Cauler Volume used 500 lb
② Diameter _____ in. Length _____ ft. Wall Thickness _____ in. Method of installation - tremie / displacement
Type: ① Steel ① Galv. ① PVC ① _____
② _____ ② _____ ② _____
Joints: ① Threaded ① Welded ① Solvent ① _____
② _____ ② _____ ② _____
Liner: Length _____ Type N/A Wall Thickness _____ in. Depth: placed from _____ ft. to _____ ft.
SCREEN N/A
Type (wire wrapped, louvered, etc.) _____ Material _____
Length _____ ft. Diameter _____ in.
Set between _____ ft. and _____ ft. Slot N/A

GROUT
Material Bentonite/Cauler Volume used 500 lb
Method of installation - tremie / displacement
Depth: placed from _____ ft. to _____ ft.
GRAVEL PACK (Filter Pack)
Material N/A Volume used _____
Method of installation _____
Depth: placed from _____ ft. to _____ ft.
Pitless Device ① Adapter ① Preassembled unit
Use of Well Commercial
① Rotary ① Cable ① Augered ① Driven ① Dug ① Other _____
Date of Completion 3-2-97

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

	From	To
Clay / Brown	0'	15'
Sand & Gravel / Brown	30'	90'
Coarse Sand Gravel / Grey	90'	100'
Broken Rock / Sand	100'	105'
Shale / grey / light	105'	129'
Liney shale hard / dark	129'	132'
Shale / dark grey	132'	140'
Sandstone H ₂ O	140'	160'
Shale H ₂ O	160'	170'
Sandstone H ₂ O	180'	→

WELL TEST


① Bailing ① Pumping* ① Other _____
Test rate 30 gpm Duration of test 48 hrs.
Drawdown _____ ft.
Measured from: ① top of casing ① ground level ① Other _____
Static Level (depth to water) 72' ft. Date: _____
Quality (clear, cloudy, taste, odor) Clear
Ph 7.4 - Iron .3 ppm - Hardness 9 grain
*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Submersible Capacity 15-18 gpm
Pump set at 130' ft.
Pump installed by Same / Dic Tabler / William Hall

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways,
street intersections, county roads, etc.

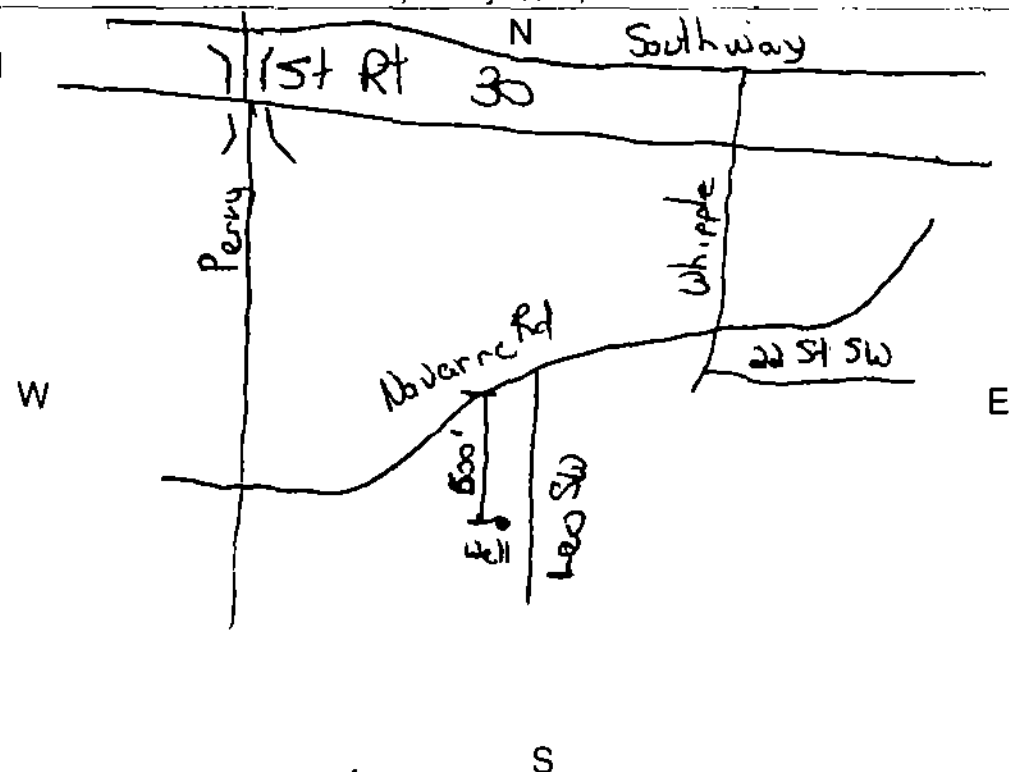

*If additional space needed, attach additional consecutively numbered form.

Drilling Firm Water Systems Inc.
Address 2317 Leo Ave S.W.
City, State, Zip Canton OH 44706

I hereby certify the information given is accurate and correct to the best of my knowledge.
Signed William Hall
Date 3-2-97
ODH Registration Number 1480