

Ohio Department of Natural Resources, Division of Water
1939 Fountain Square Drive, Columbus, Ohio 43224 Phone (614) 265-6739
Permit Number

614) 265-6739
Permit Number 4248

COUNTY Columbiana TOWNSHIP Hanover SECTION/LOT No. _____
(CIRCLE ONE)
OWNER/BUILDER Chuck Foster PROPERTY ADDRESS 30468 Spidel Rd
(CIRCLE ONE OR BOTH) (ADDRESS OR WELL LOCATION ▲)
LOCATION OF PROPERTY Dane Kensington

CONSTRUCTION DETAILS

CASING		Borehole Diameter <u>8</u> in.		GROUT	
☒ 1 Diameter <u>6</u> in.	Length <u>34</u> ft.	Wall Thickness <u>250</u> in.	Material <u>Drilling Mud</u>	Volume used <u>55 gal</u>	
☐ 2 Diameter _____ in.	Length _____ ft.	Wall Thickness _____ in.	Method of installation <u>poured</u>		
Type: ☒ 1 Steel	☒ 1 Galv.	☒ 1 PVC	Depth: placed from <u>0</u> ft. to <u>25</u> ft.		
☐ 2 _____	☐ 2 _____	☐ 2 Other _____	GRAVEL PACK (Filter Pack)		
Joints: ☒ 1 Threaded	☒ 1 Welded	☒ 1 Solvent	Material _____	Volume used _____	
☐ 2 _____	☐ 2 _____	☐ 2 Other _____	Method of installation _____		
Liner: Length <u>164</u>	Type <u>PVC</u>	Wall Thickness <u>26</u> in.	Depth: placed from _____ ft. to _____ ft.		
SCREEN					
Type (wire wrapped, louvered, etc.) _____		Material _____			
Length _____ ft.	Diameter _____ in.				
Set between _____ ft. and _____ ft.	Slot _____				
		Pitless Device ☒ Adapter ☐ Preassembled unit Use of Well <u>indw</u> ☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Dug ☐ Other _____ Date of Completion <u>Aug. 31, 1995</u>			

WELL LOG*

INDICATE DEPTH(S) AT WHICH WATER IS ENCOUNTERED.

Show color, texture, hardness, and formation:
sandstone, shale, limestone, gravel, clay, sand, etc.

[illegible]

WELL TEST

☒ Bailing ☐ Pumping* ☐ Other _____

Test rate 8 gpm Duration of test 2 hrs.

Drawdown 20 ft.

Measured from: ☐ top of casing ☒ ground level ☐ Other _____

Static Level (depth to water) 85 ft. Date: Aug 30, 1995

Quality (clear, cloudy, taste, odor) _____


*(Attach a copy of the pumping test record, per section 1521.05, ORC)

PUMP

Type of pump Boneda Capacity 7 gpm
Pump set at 160' ft.
Pump installed by K. Ferguson

SKETCH SHOWING WELL LOCATION

Show distances well lies from numbered state highways, street intersections, county roads, etc.

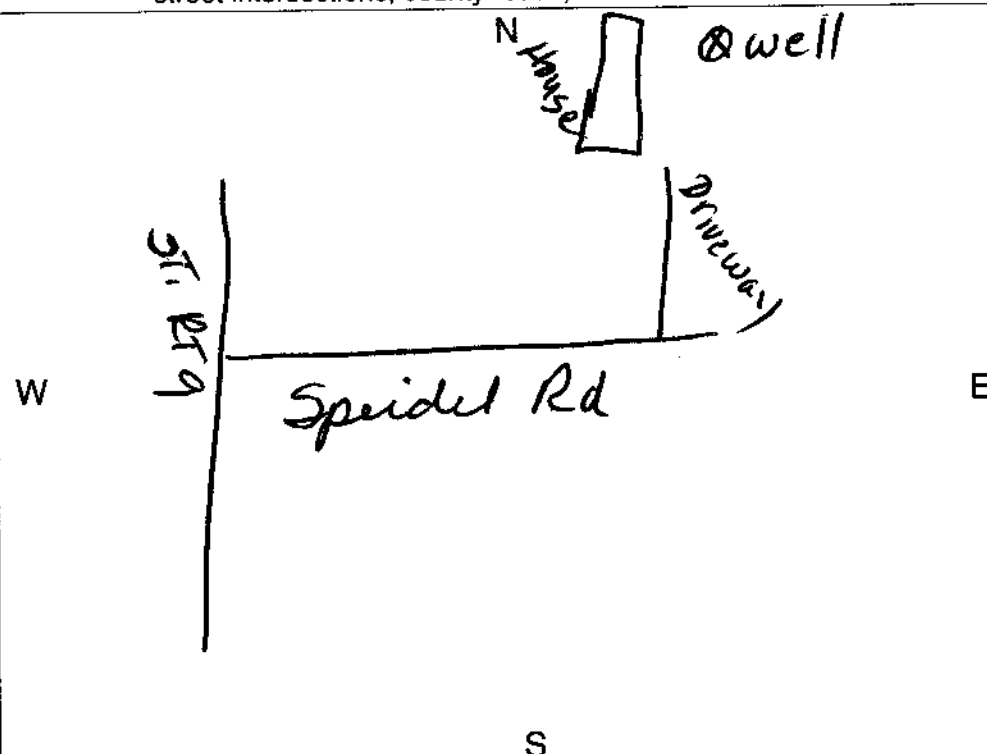

*If additional space is needed, complete well log, use next consecutively numbered form.

I hereby certify the information given is accurate and correct to the best of my knowledge.

Drilling Firm Forgotten Drilling
Address 1215 Willow Lane

Signed Kevin Ferguson LF
Date Sept. 23, 1995

City, State, Zip Wellsville, Oh

ODH Registration Number 658

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.
ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224

Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy

5197