

Ohio Department of Natural Resources
Division of Water, 1939 Fountain Square Drive
Columbus, Ohio 43224-9971 Voice (614) 265-6739 Fax (614) 447-9503

CONSTRUCTION DETAILS

☐ Rotary ☒ Cable ☐ Augered ☐ Driven ☐ Other _____

BOREHOLE/CASING (measured from ground surface)

1 ☒ Borehole Diameter 7" inches Depth 170' ft.
Casing Diameter 6 3/8" in. Length 24' ft. Thickness 20 lbs in.

2 ☐ Borehole Diameter 5" inches Depth 180' ft.
Casing Diameter 4 3/4" in. Length 170' ft. Thickness 16 lbs in.

Casing Height Above Ground -1' ft.

Type 1 ☒ Steel 1 ☐ Galv. 1 ☐ PVC 1 ☐ _____
2 ☒ _____ 2 ☐ _____ 2 ☐ _____ 2 ☐ Other _____

Joints 1 ☒ Threaded 1 ☐ Welded 1 ☐ Solvent 1 ☐ _____
2 ☒ _____ 2 ☐ _____ 2 ☐ _____ 2 ☐ Other _____

SCREEN

Diameter _____ Slot Size _____ Screen Length _____ ft.

Type _____ Material _____

Set Between _____ ft. and _____ ft.

GRAVEL PACK (Filter Pack)

GRAVEL PACK (Filter Pack)

Material/Size _____ Volume/Weight Used _____

Method of Installation _____


Depth: Placed FROM _____ ft. TO _____ ft.

GROUT

Material Fine Clay Volume/Weight Used 15-80 bags

Method of Installation Gravity

Depth: Placed FROM 170' ft. TO 5' ft.

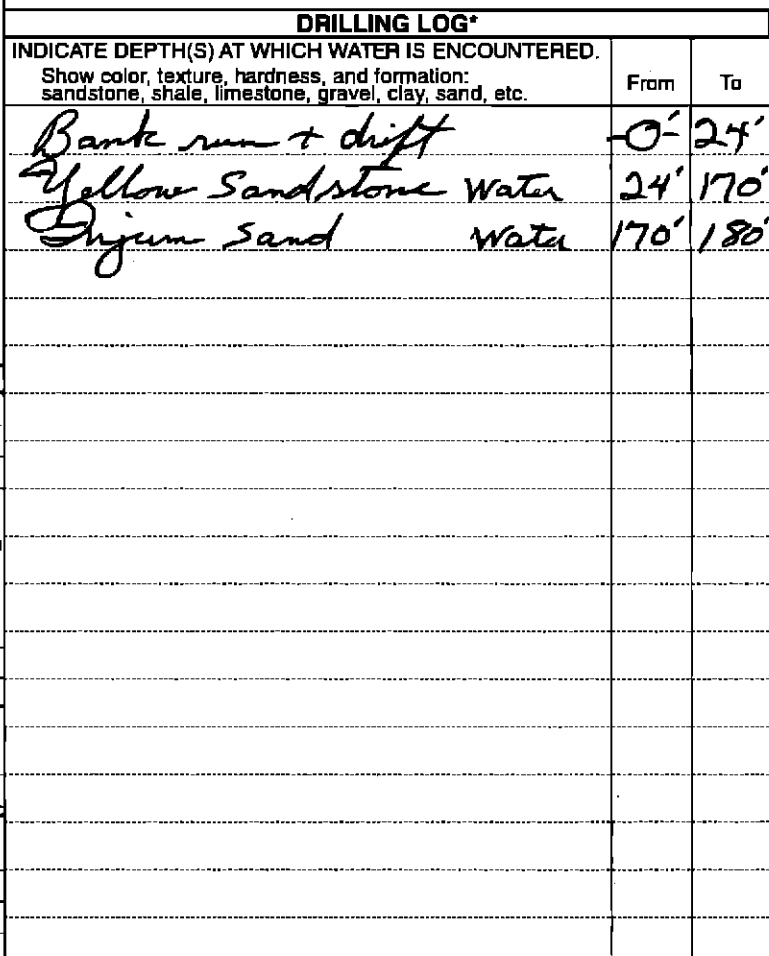

Pre-Pumping Static Level 25 ft. Date 11-10-99
Measured from: ☒ Top of Casing ☐ Ground Level ☐ Other _____
☐ Air ☒ Bailing ☐ Pumping* ☐ Other _____
Test Rate 20 + gpm Duration of Test 24 hrs.
Feet of Drawdown 30 ft. Sustainable Yield 25 gpm
(Attach a copy of the pumping test record, per section 1521.05, ORC)
Is Copy Attached? ☐ Yes ☒ No Flowing Well? ☐ Yes ☐ No
Quality Clear

Type of pump _____ Capacity _____ gpm
Pump set at _____ ft. Pitless Type _____
Pump installed by Home Owner
I hereby certify the information given is accurate and correct to the best of my knowledge.
Drilling Firm Markle Drilling & Pump
Address 5917 Refugio Rd. NE
City, State, Zip Newark OH. 43055
Signed Jerry H. Markle Date 2-29-00
ODH Registration Number 512

Date of Well Completion 11-10-99 Total Depth of Well 180' ft

Completion of this form is required by section 1521.05, Ohio Revised Code - file within 30 days after completion of drilling.
ORIGINAL COPY TO - ODNR, DIVISION OF WATER, 1939 FOUNTAIN SQ. DRIVE, COLS., OHIO 43224-9971
Blue - Customer's copy Pink - Driller's copy Green - Local Health Dept. copy